

25

Interior Sign Installation Guidelines

General Contractor: Hensel Phelps
Project: UCR MRB1
Developed By: Century Sign Builders

2010 ADA Standards for Accessible Design


703.4 Installation Height and Location. Signs with tactile characters shall comply with 703.4.

703.4.1 Height Above Finish Floor or Ground. Tactile characters on signs shall be located 48 inches (1220 mm) minimum above the finish floor or ground surface, measured from the baseline of the lowest tactile character and 60 inches (1525 mm) maximum above the finish floor or ground surface, measured from the baseline of the highest tactile character.


703.4.2 Location. Where a tactile sign is provided at a door, the sign shall be located alongside the door at the latch side. Where a tactile sign is provided at double doors with one active leaf, the sign shall be located on the inactive leaf. Where a tactile sign is provided at double doors with two active leaves, the sign shall be located to the right of the right hand door. Where there is no wall space at the latch side of a single door or at the right side of double doors, signs shall be located on the nearest adjacent wall. Signs containing tactile characters shall be located so that a clear floor space of 18 inches (455 mm) minimum by 18 inches (455 mm) minimum, centered on the tactile characters, is provided beyond the arc of any door swing between the closed position and 45 degree open position. EXCEPTION: Signs with tactile characters shall be permitted on the push side of doors with closers and without hold-open devices.

Century Sign Builders Installation Standard Placement


1. Tactile characters on signs shall be placed a minimum of 9" OC from the door swing on the latch side.
2. All though not required for doors that open in, CSB will install signs in the same location as shown in Illustration 1, for consistency.

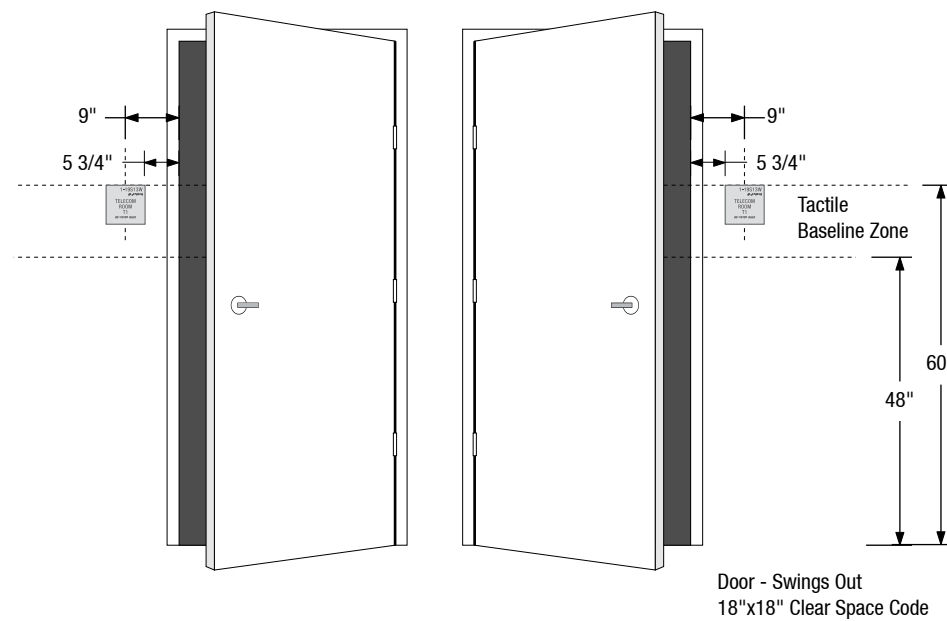

A DOOR ELEVATIONS
SCALE: 3/8" = 1'

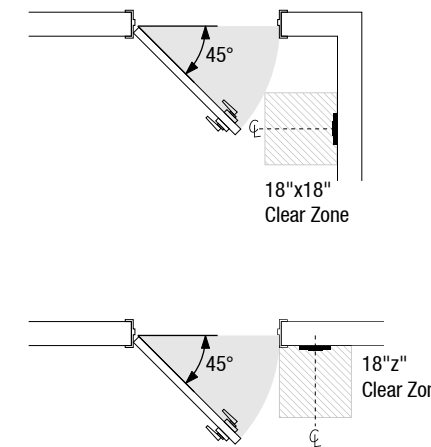

B PLAN VIEW - CLEAR ZONE
SCALE: 1/4" = 1'

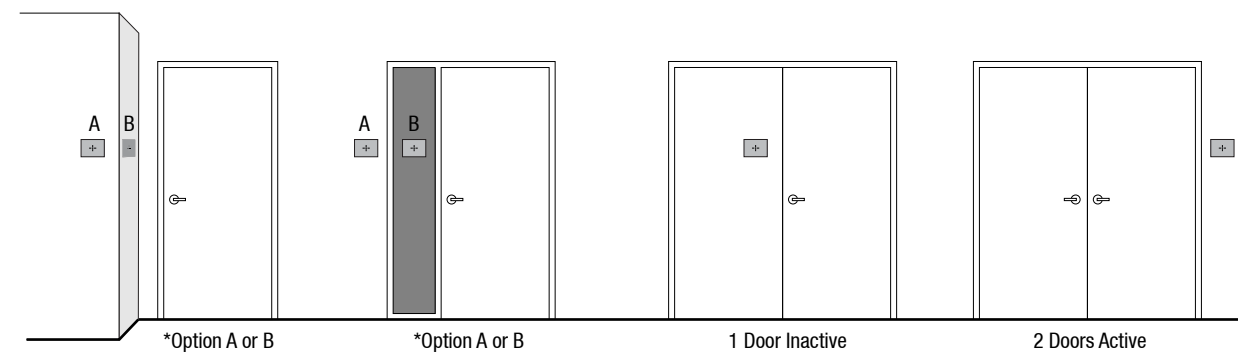

C OTHER CONDITIONS
SCALE: 3/16" = 1'

*Placement A or B Considerations:
Clear Zone Code & Consistency


FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs



CONTACT	DRAWN BY	CLIENT / PROJECT	DATE	SHEET TITLE	SHEET
Albuquerque / Phoenix P 505.888.2901 ext 109 F 505.888.2902 csbsigns.com	Lawrence Spingola Lawrence Spingola@csbsigns.com <small>This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.</small>	Client / GC: Hensel Phelps Project: University of California, Riverside - MRB1	Modification Date: July 24, 2018 4:03 PM	Install Guidelines ADA sign installation	26
		APPROVAL REQUIRED FOR PRODUCTION	SIGNATURE / DATE		


Sign installation instructions based on the following 2013 and 2016 California Building Code:

- 11B-703.4 Installation Height and Location
- 11B-703.4.1 Height Above Finish Floor or Ground
- 11B-703.4.2 Location
- 1115B.5.1 Tactile Restroom Identification (2007 CBC)
- 1023.9 Stairway identification signs

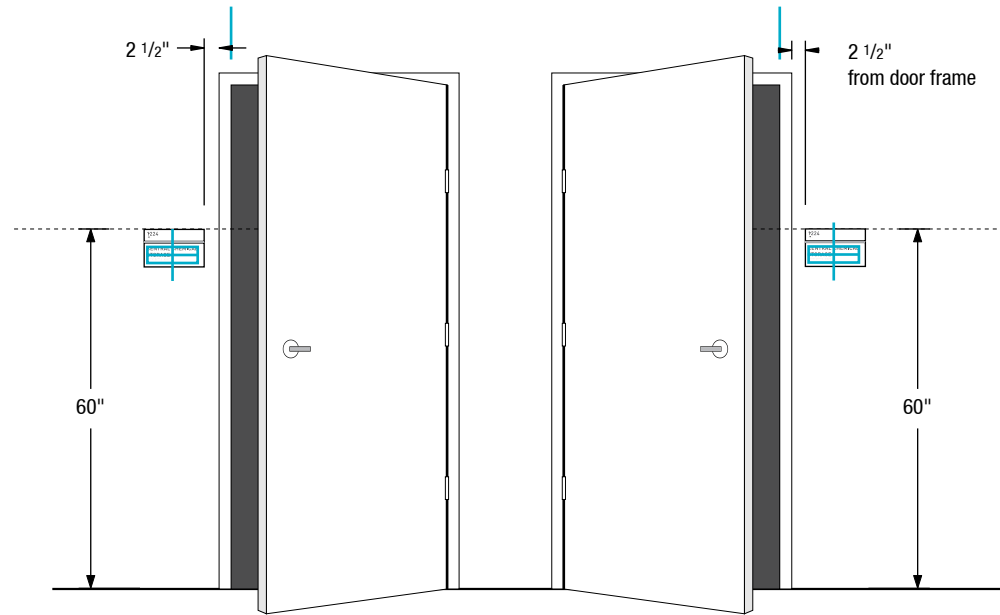


B **SIGN TYPE B70**
SCALE: 3/8" = 1'

Door - Swings Out
18"x18" Clear Space Code

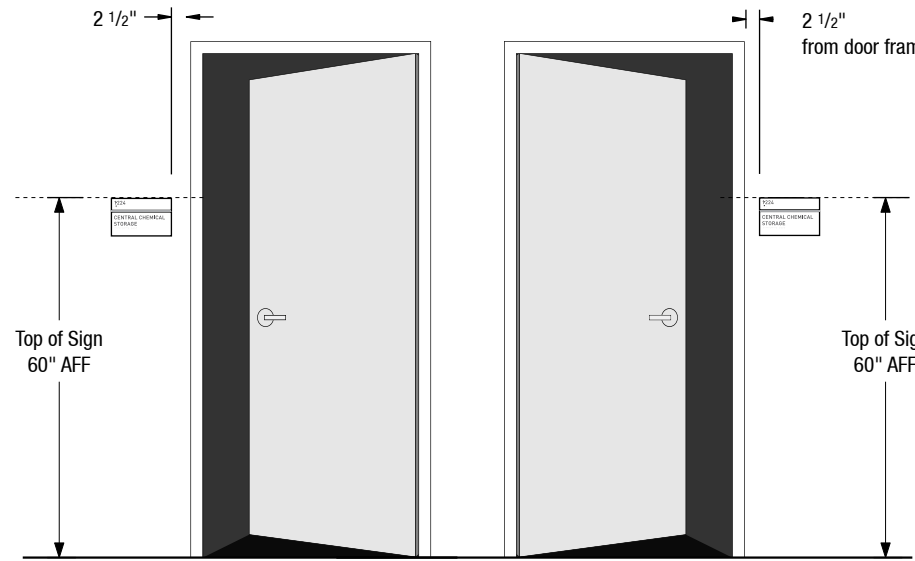


C **SIGN TYPE B70**
SCALE: 3/8" = 1'

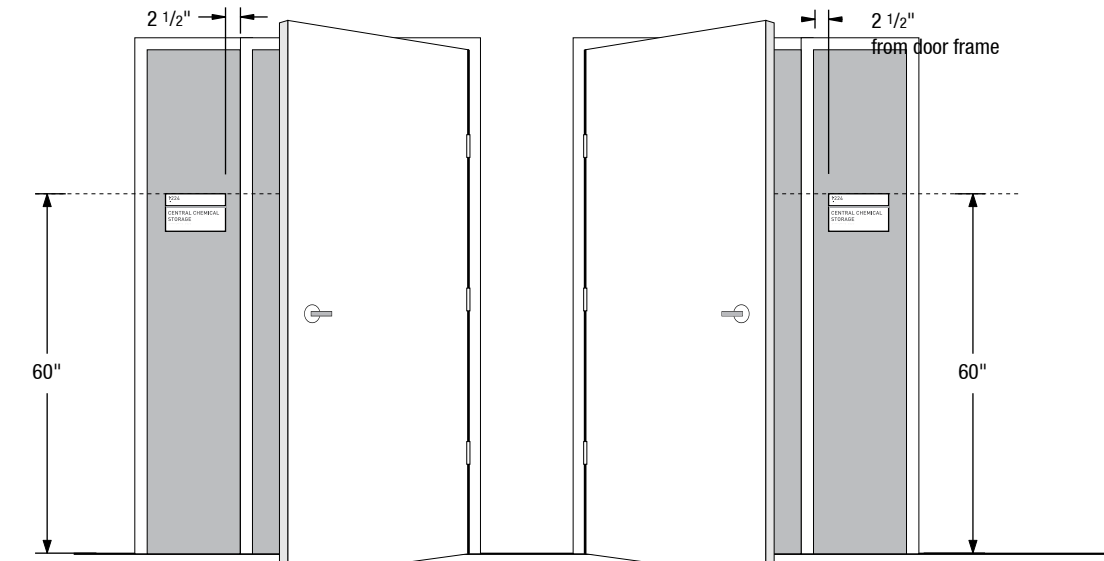


D **SIGN TYPE B70 SIDELIGHT**
SCALE: 3/8" = 1'

Door - Swings Out
18"x18" Clear Space Code

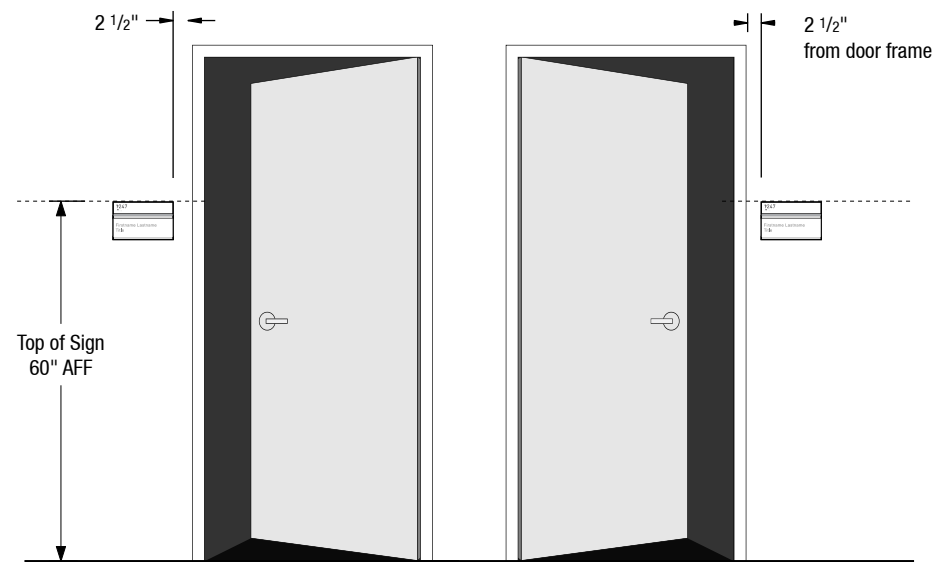

E **SIGN TYPE B31**
SCALE: 3/8" = 1'

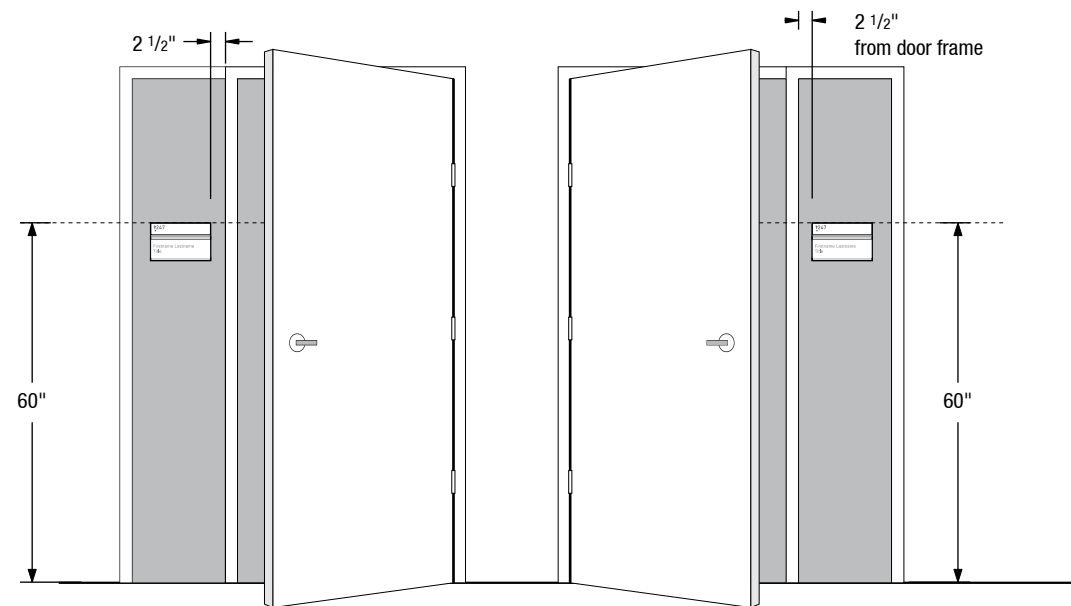

F **SIGN TYPE B70 SIDELIGHT**
SCALE: 3/8" = 1'

Door - Swings Out
18"x18" Clear Space Code

FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs



CONTACT
Albuquerque / Phoenix
P 505.888.2901 ext 109
F 505.888.2902
csbsigns.com

DRAWN BY
Lawrence Spingola
Lawrence.Spingola@csbsigns.com

This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.

CLIENT / PROJECT
Client / GC: Hensel Phelps
Project: University of California, Riverside - MRB1

APPROVAL REQUIRED FOR PRODUCTION


SIGNATURE / DATE

DATE
Modification Date: July 24, 2018 4:03 PM

SHEET TITLE **SHEET**


Install Guidelines
Room Signs, Office Signs

27

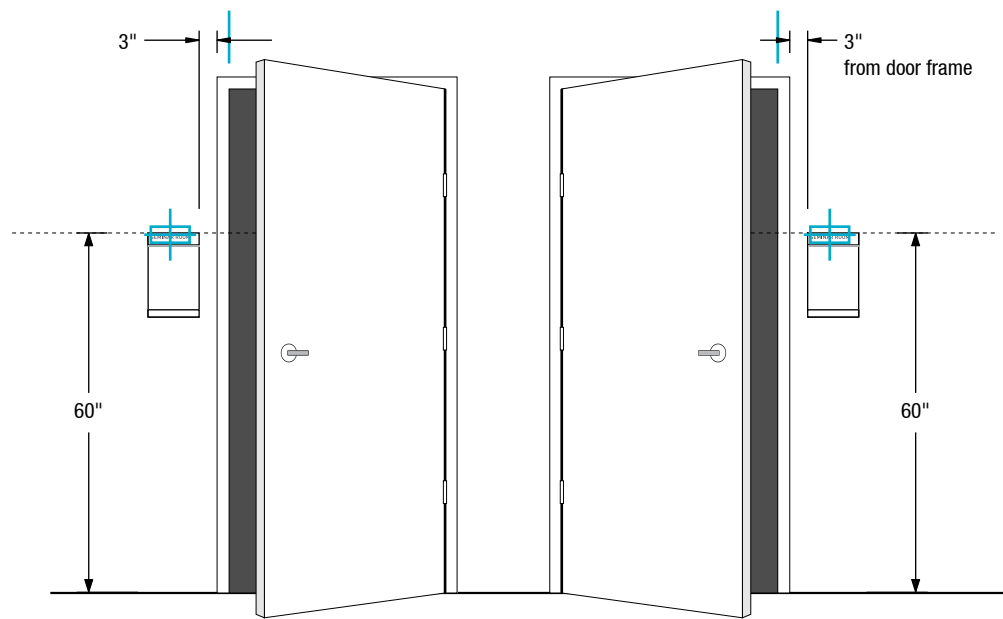

A **SIGN TYPE B32**
SCALE: 3/8" = 1'


Door - Swings Out
18"x18" Clear Space Code

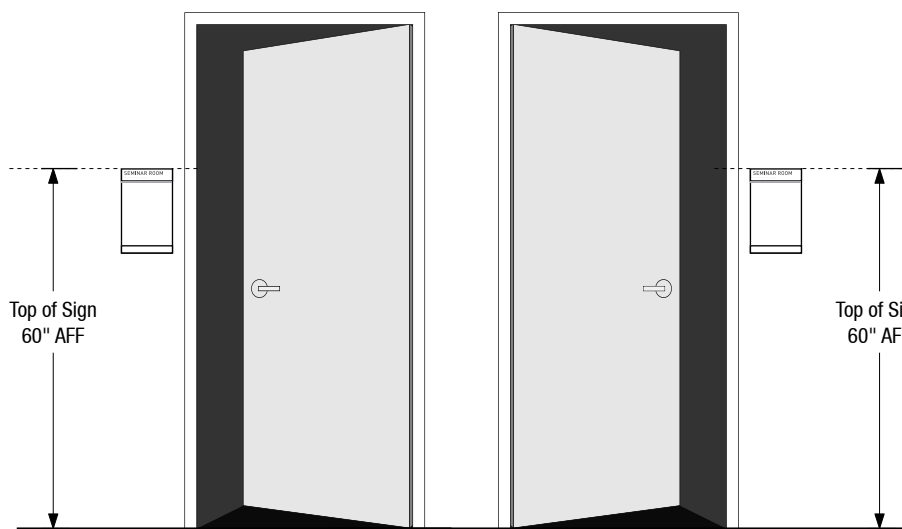

B **SIGN TYPE B32**
SCALE: 3/8" = 1'


Top of Sign
60" AFF

Top of Sign
60" AFF

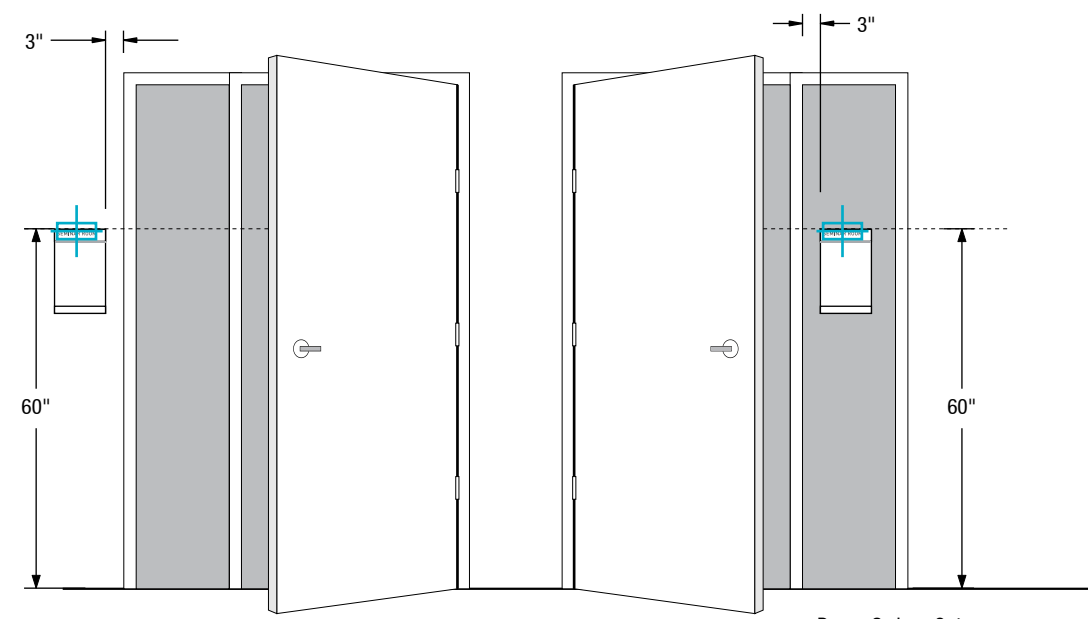


C **SIGN TYPE B32 SIDELIGHT**
SCALE: 3/8" = 1'

Door - Swings Out
18"x18" Clear Space Code

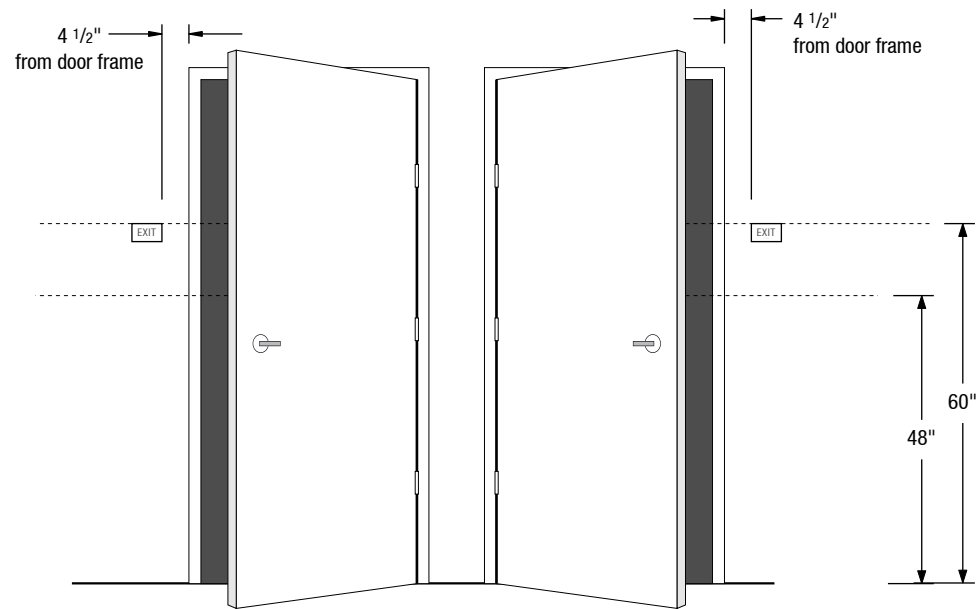

D **EXIT SIGN - SIGN TYPE E**
SCALE: 3/8" = 1'


Door - Swings Out
18"x18" Clear Space Code

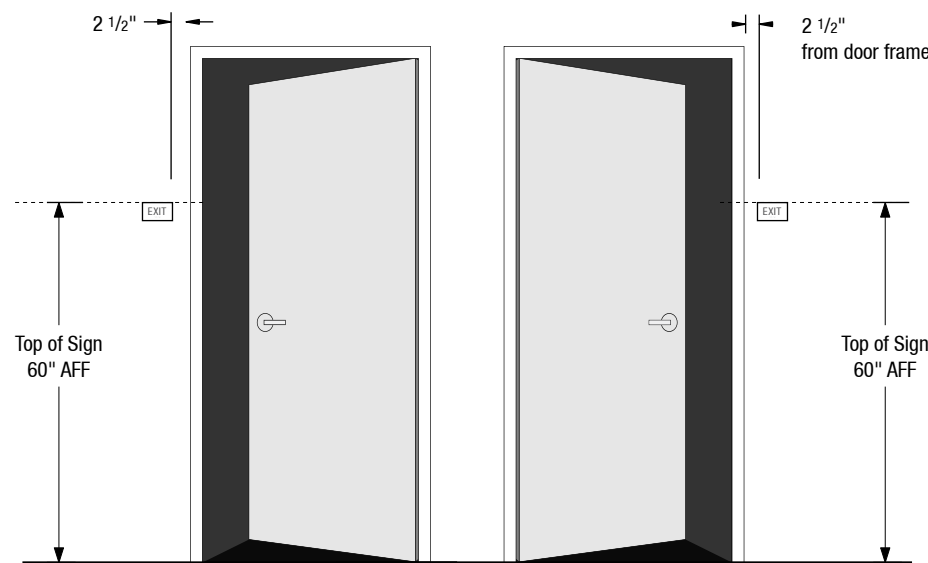

E **EXIT SIGN - SIGN TYPE E**
SCALE: 3/8" = 1'

Top of Sign
60" AFF

Top of Sign
60" AFF

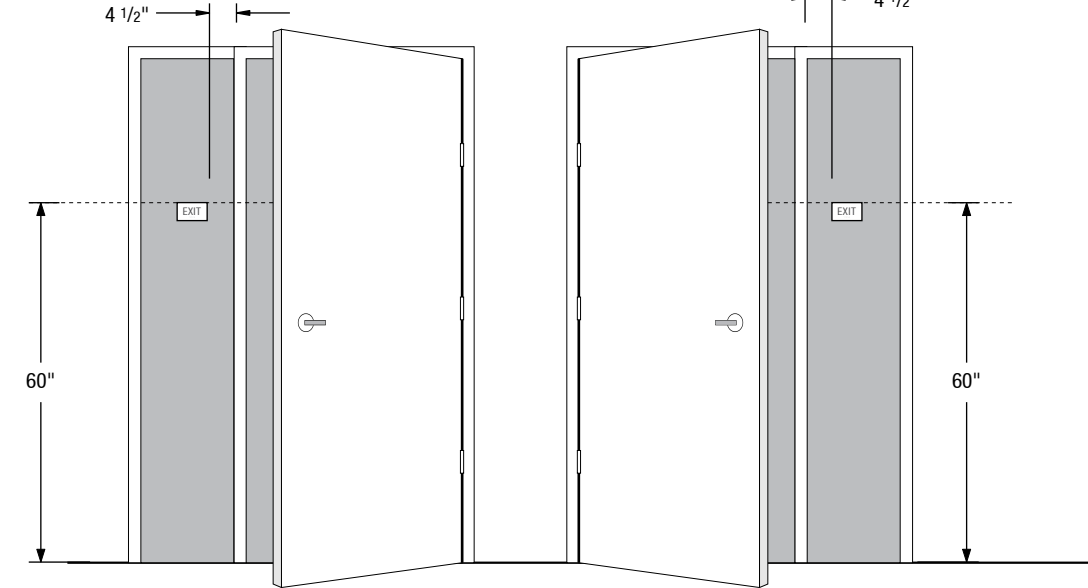

F **SIGN TYPE E SIDELIGHT**
SCALE: 3/8" = 1'

Door - Swings Out
18"x18" Clear Space Code

FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs



CONTACT
Albuquerque / Phoenix
P 505.888.2901 ext 109
F 505.888.2902
csbsigns.com

DRAWN BY
Lawrence Spingola
Lawrence.Spingola@csbsigns.com

This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.

CLIENT / PROJECT
Client / GC: Hensel Phelps
Project: University of California, Riverside - MRB1

APPROVAL REQUIRED FOR PRODUCTION


SIGNATURE / DATE

DATE
Modification Date: July 24, 2018 4:03 PM

SHEET TITLE


Install Guidelines
Conference Room, Exit Signs

28

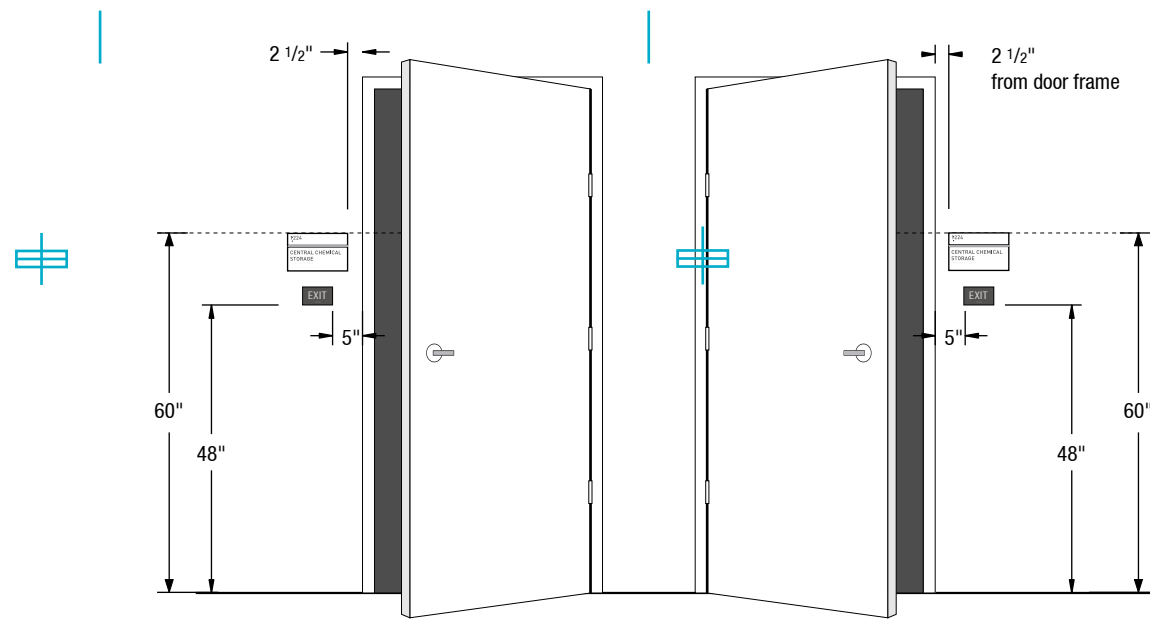

Door - Swings Out
18"x18" Clear Space Code

A **DUAL SIGN - B70 AND EXIT**
SCALE: 3/8" = 1'

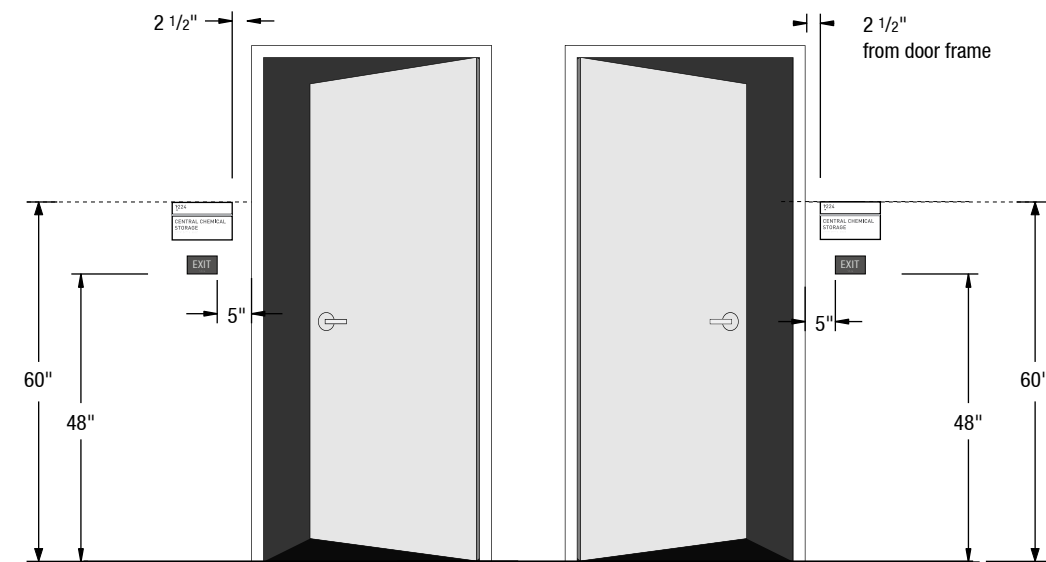


B **DUAL SIGN - B70 AND EXIT**
SCALE: 3/8" = 1'


FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs

CONTACT	DRAWN BY	CLIENT / PROJECT	DATE	SHEET TITLE	SHEET
Albuquerque / Phoenix P 505.888.2901 ext 109 F 505.888.2902 csbsigns.com	Lawrence Spingola Lawrence Spingola@csbsigns.com <small>This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.</small>	Client / GC: Hensel Phelps Project: University of California, Riverside - MRB1 APPROVAL REQUIRED FOR PRODUCTION	Modification Date: July 24, 2018 4:03 PM SIGNATURE / DATE	Install Guidelines Dual ADA Room Signs	29




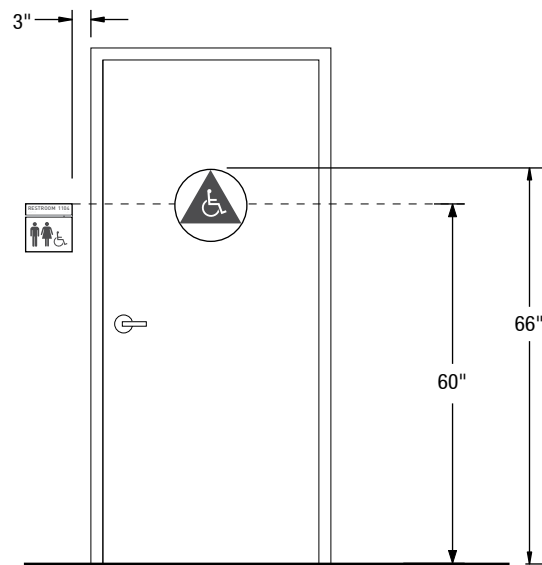


A RESTROOM DOOR - SIGN TYPE ST36 AND ST80
SCALE: 3/8" = 1'

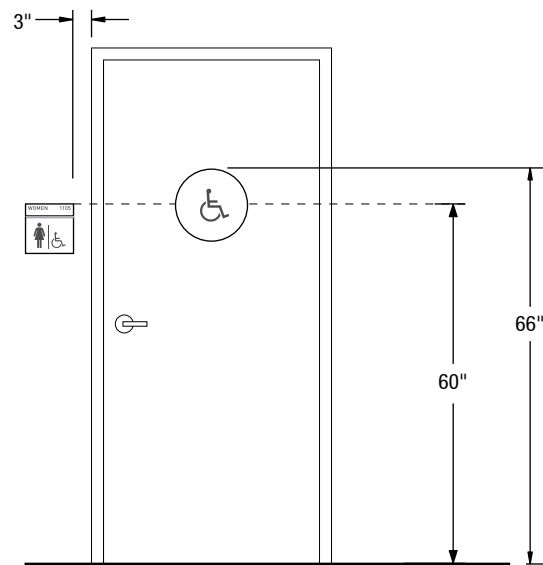


B WOMENS RESTROOM DOOR - SIGN TYPE ST36 AND ST80
SCALE: 3/8" = 1'

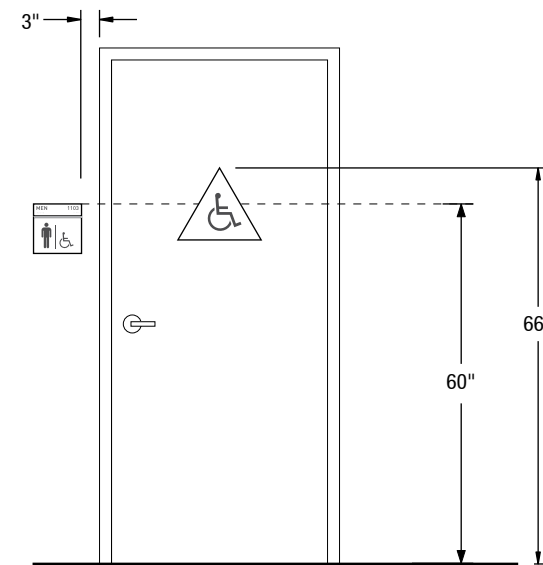


C MENS RESTROOM DOOR - SIGN TYPE ST36 AND ST80
SCALE: 3/8" = 1'

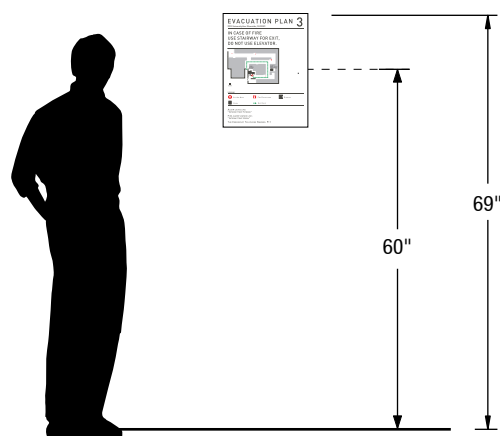

D EVACUATION MAP - SIGN TYPE B75
SCALE: 3/8" = 1'

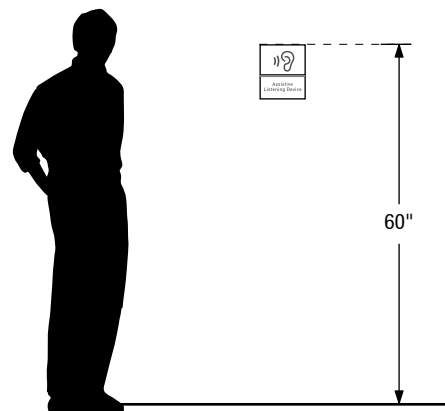

E ASSISTIVE LISTENING DEVICE - SIGN TYPE B60
SCALE: 3/8" = 1'

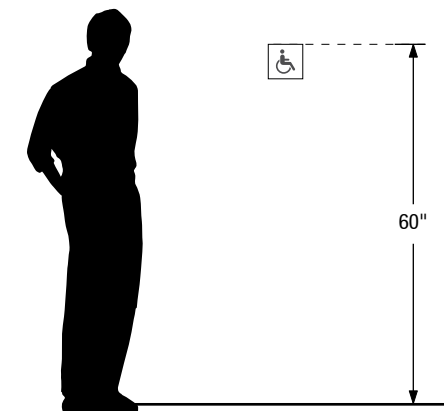

F ACCESSIBLE ID - SIGN TYPE B92
SCALE: 3/8" = 1'

FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs



CONTACT
Albuquerque / Phoenix
P 505.888.2901 ext 109
F 505.888.2902
csbsigns.com

DRAWN BY
Lawrence Spingola
Lawrence.Spingola@csbsigns.com
This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.

CLIENT / PROJECT
Client / GC: Hensel Phelps
Project: University of California, Riverside - MRB1



APPROVAL REQUIRED FOR PRODUCTION
SIGNATURE / DATE

DATE
Modification Date: July 24, 2018 4:03 PM


SHEET TITLE
Install Guidelines
Restrooms, Evac Maps, ALD,
Accessible ID

SHEET
30

TYPICAL STAIRWELL SIGNAGE

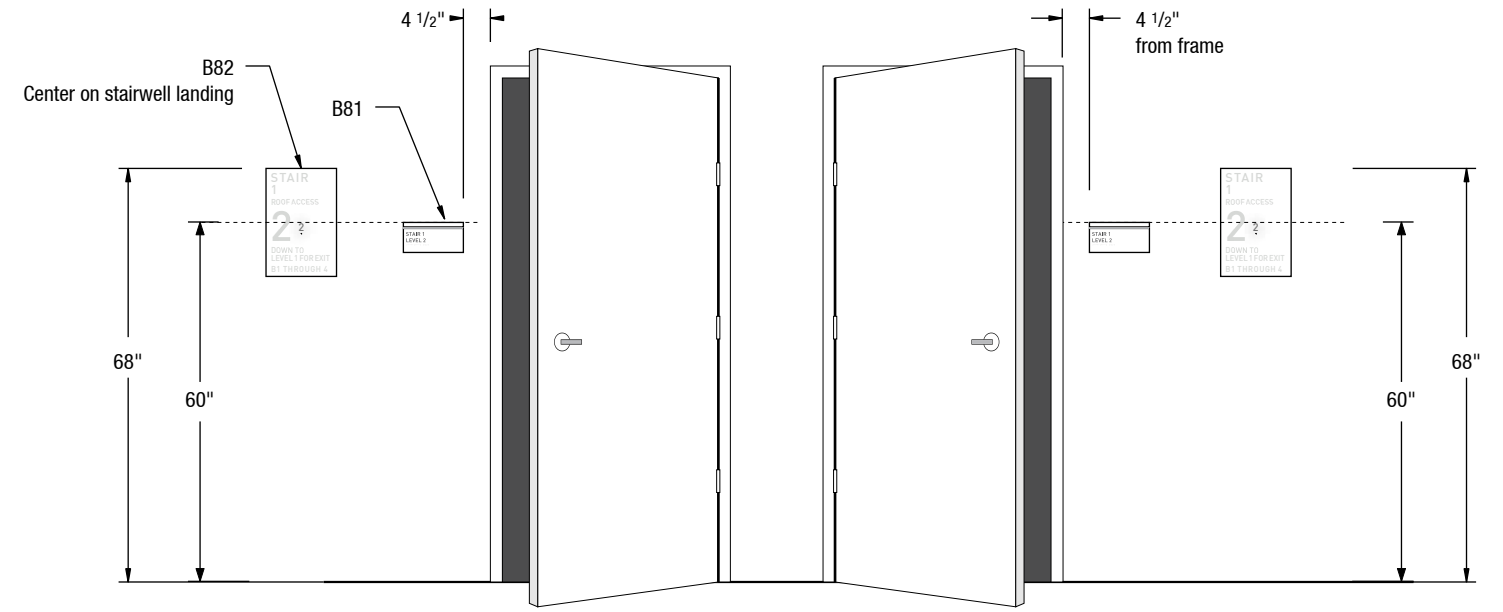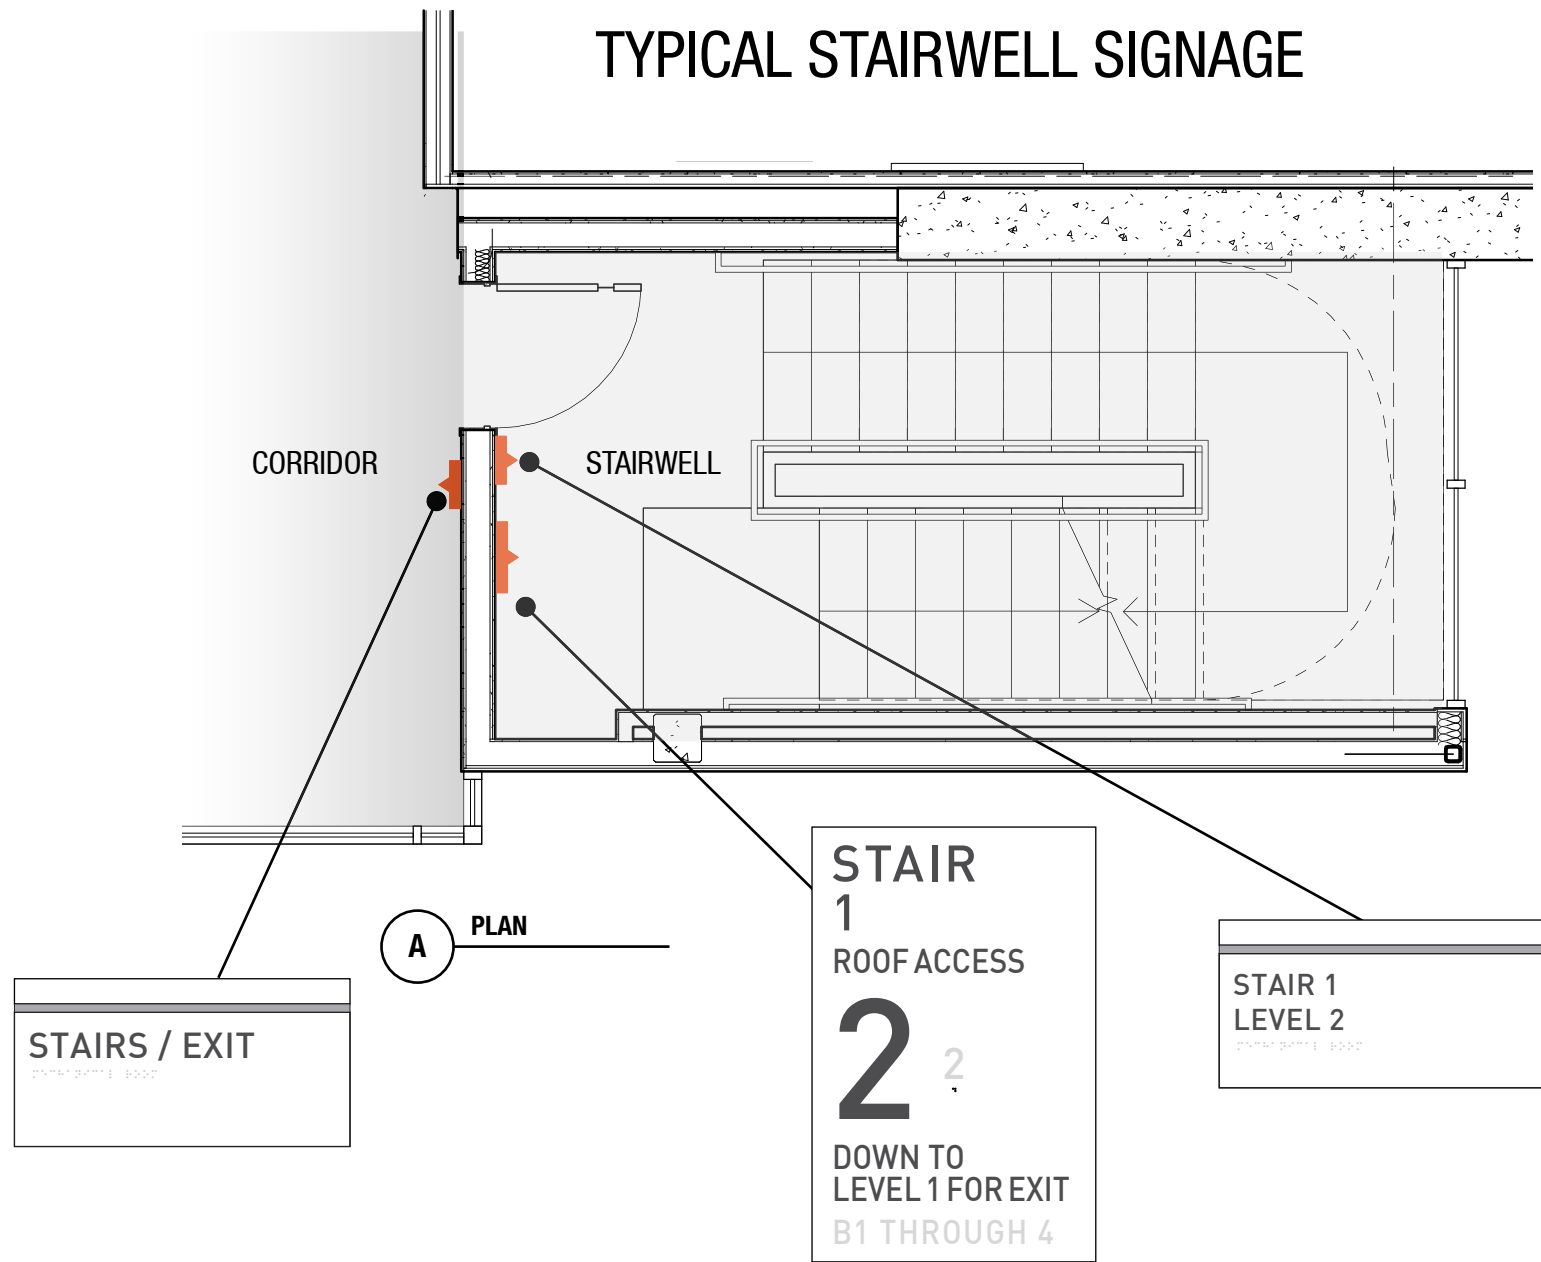

B STAIRWELL LANDING - SIGN TYPE B81 AND B82
SCALE: 3/8" = 1'

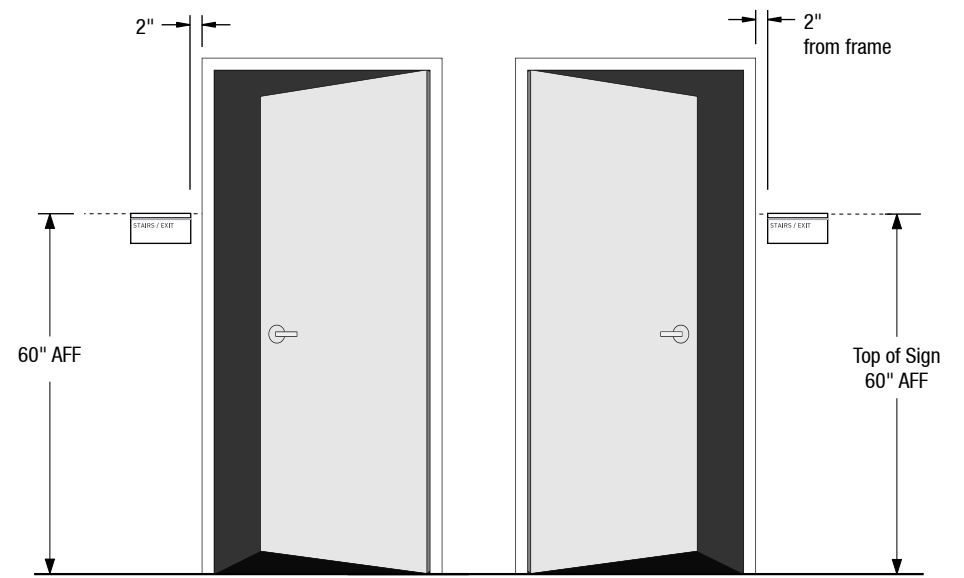


C SIGN TYPE B81 -STAIR DOOR
SCALE: 3/8" = 1'

FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs

CONTACT	DRAWN BY	CLIENT / PROJECT	DATE	SHEET TITLE	SHEET
Albuquerque / Phoenix P 505.888.2901 ext 109 F 505.888.2902 csbsigns.com	Lawrence Spingola Lawrence Spingola@csbsigns.com This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.	Client / GC: Hensel Phelps Project: University of California, Riverside - MRB1 APPROVAL REQUIRED FOR PRODUCTION	Modification Date: July 24, 2018 4:03 PM	Install Guidelines Stair Signs	31
		SIGNATURE / DATE			



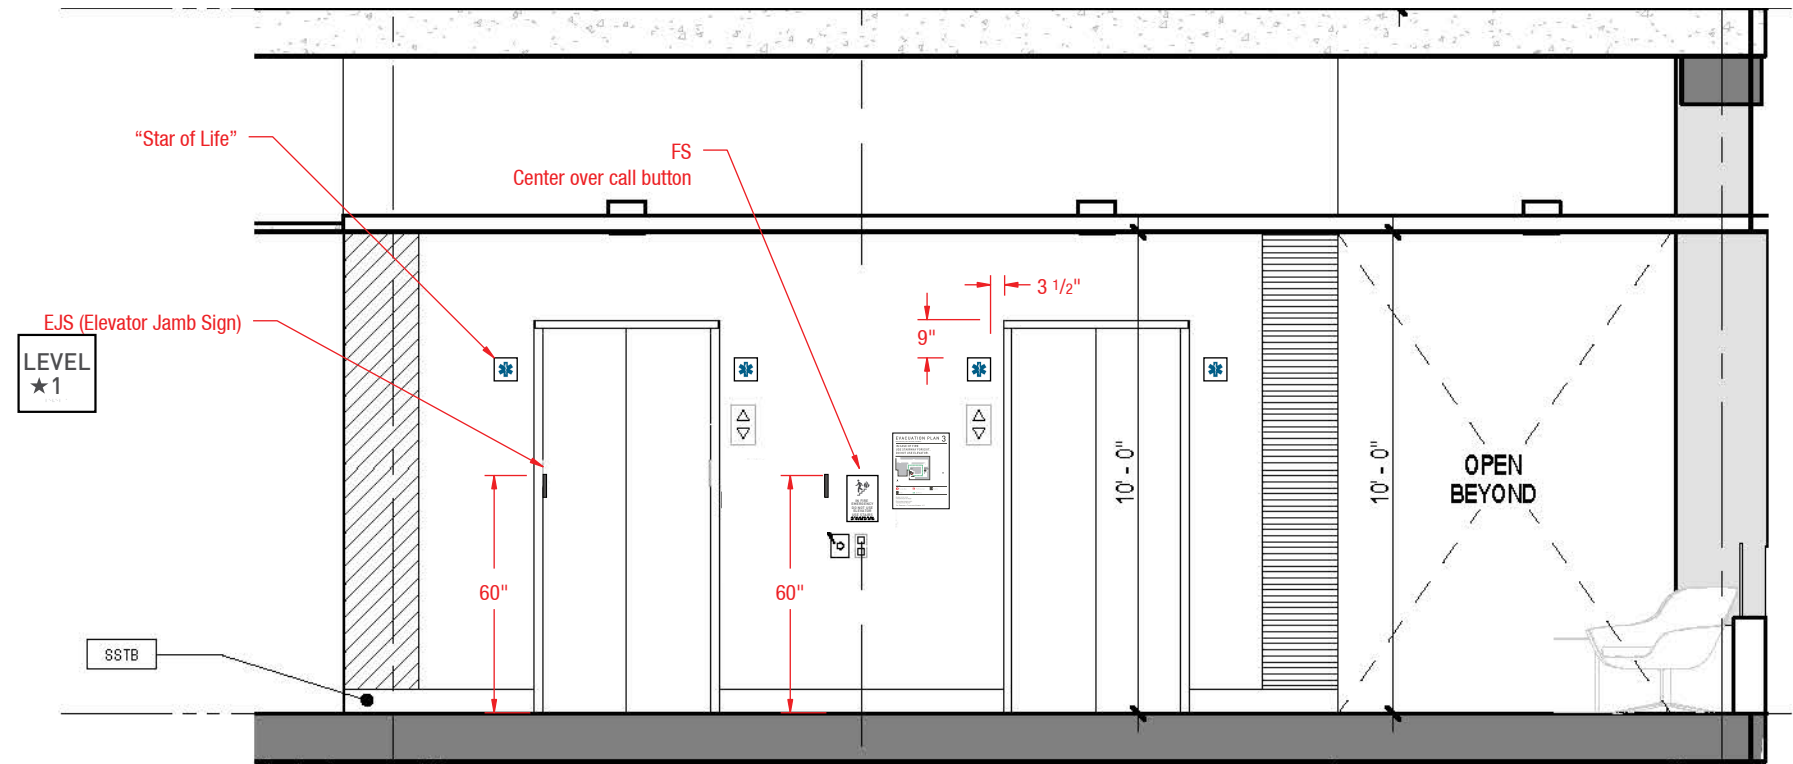

A **ELEVATOR BAY SIGNS - SIGN TYPE FS (FIRE SAFETY), EJS (ELEVATOR JAMB), B75 EVAC MAP, STAR OF LIFE**
 SCALE: 1/4" = 1'

FILE PATH Q:\UCR MRB1\20180426 UCR Contract\Renderings, Submittals & PDFs\Submittals\Archive\UCR MRB1_Interior Code Signs



CONTACT
 Albuquerque / Phoenix
 P 505.888.2901 ext 109
 F 505.888.2902
 csbsigns.com

DRAWN BY
 Lawrence Spingola
 Lawrence Spingola@csbsigns.com

This artwork and design is owned by Century Sign Builders unless expressly stated. Use of this document or the design shown here without permission is prohibited.

CLIENT / PROJECT
 Client / GC: Hensel Phelps
 Project: University of California, Riverside - MRB1


APPROVAL REQUIRED FOR PRODUCTION

SIGNATURE / DATE

DATE
 Modification Date: July 24, 2018 4:03 PM

SHEET TITLE
Install Guidelines
 Elevator Bay


SHEET
32

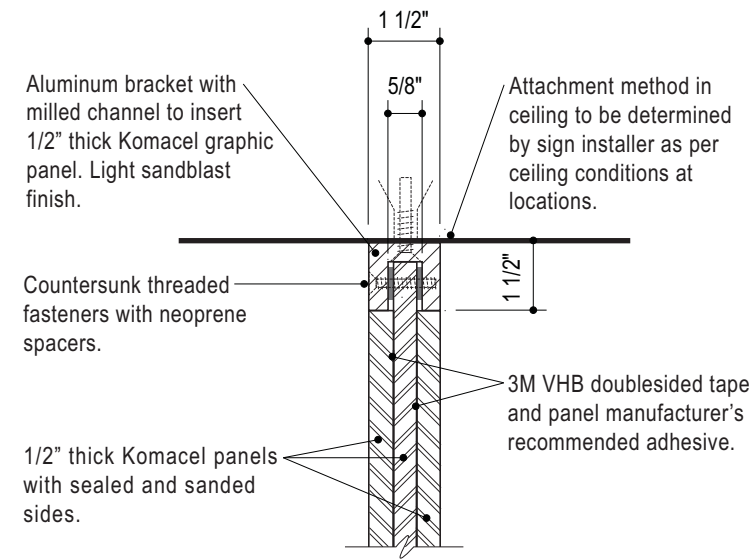

(A) SECTION | 3"=1'-0"


GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

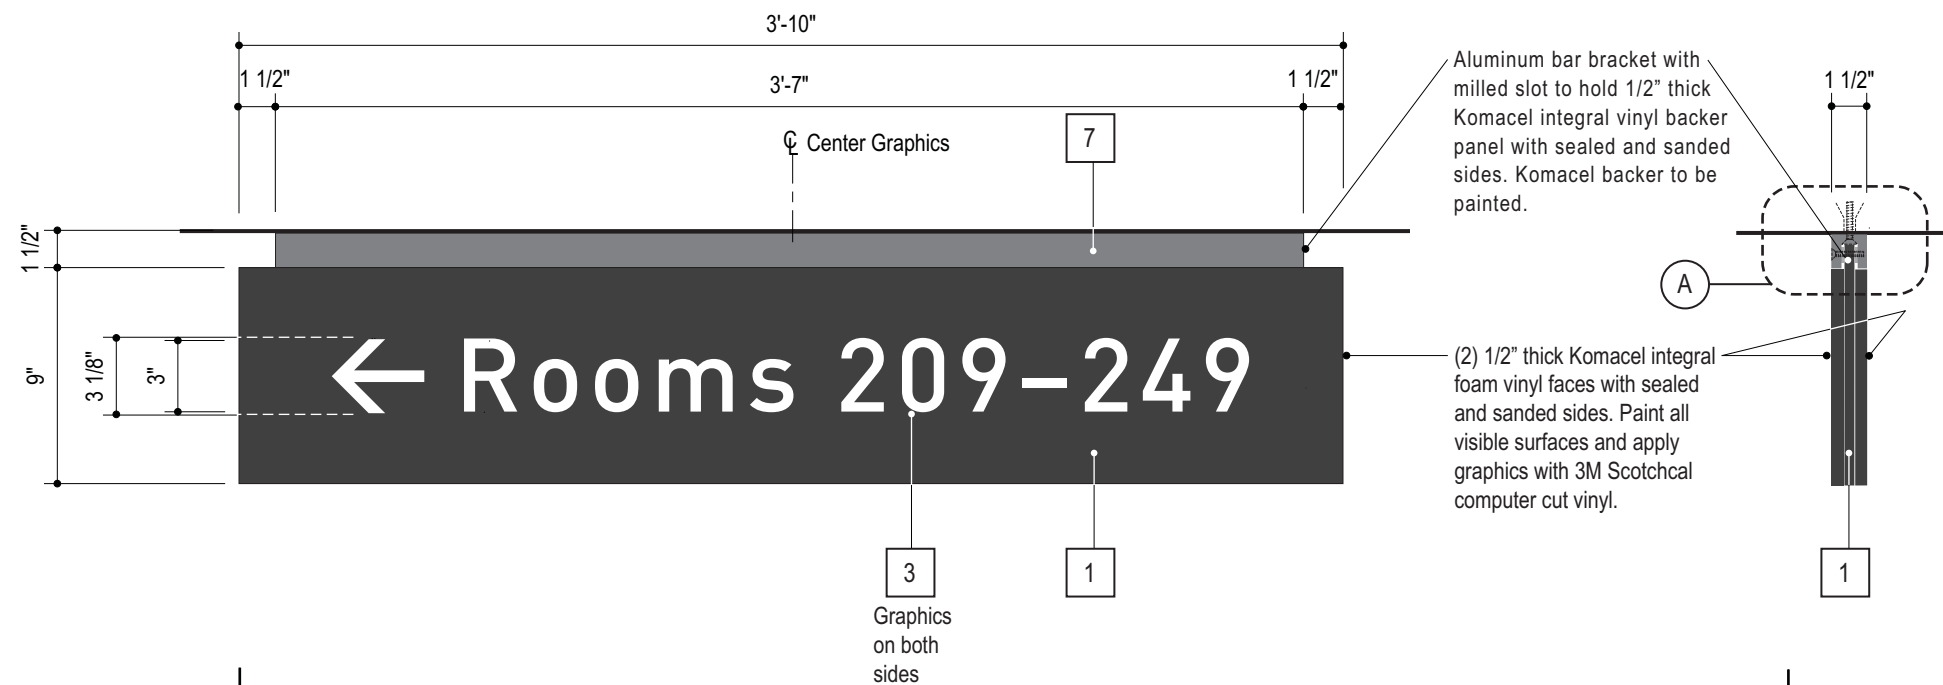


ELEVATION | 1 1/2"=1'-0"

SIDE VIEW | 1 1/2"=1'-0"

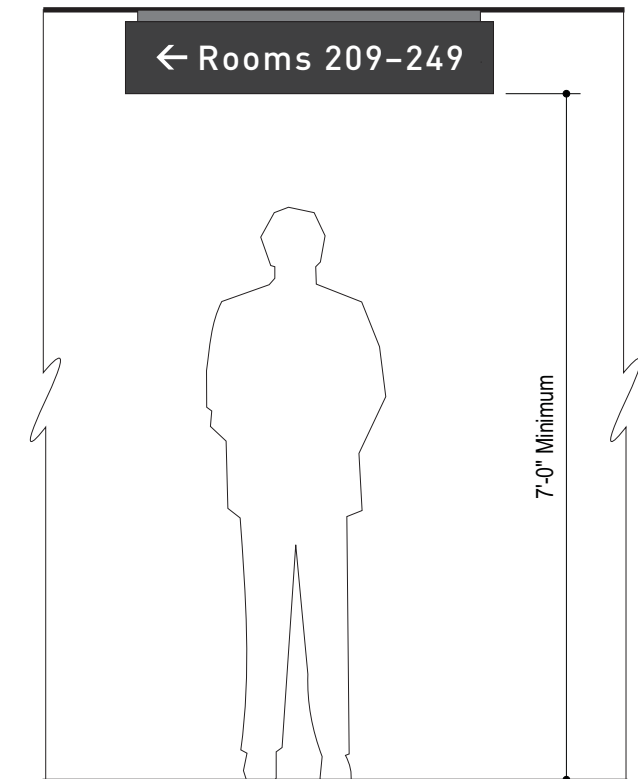


LOCATION ELEVATION | 1/2"=1'-0"

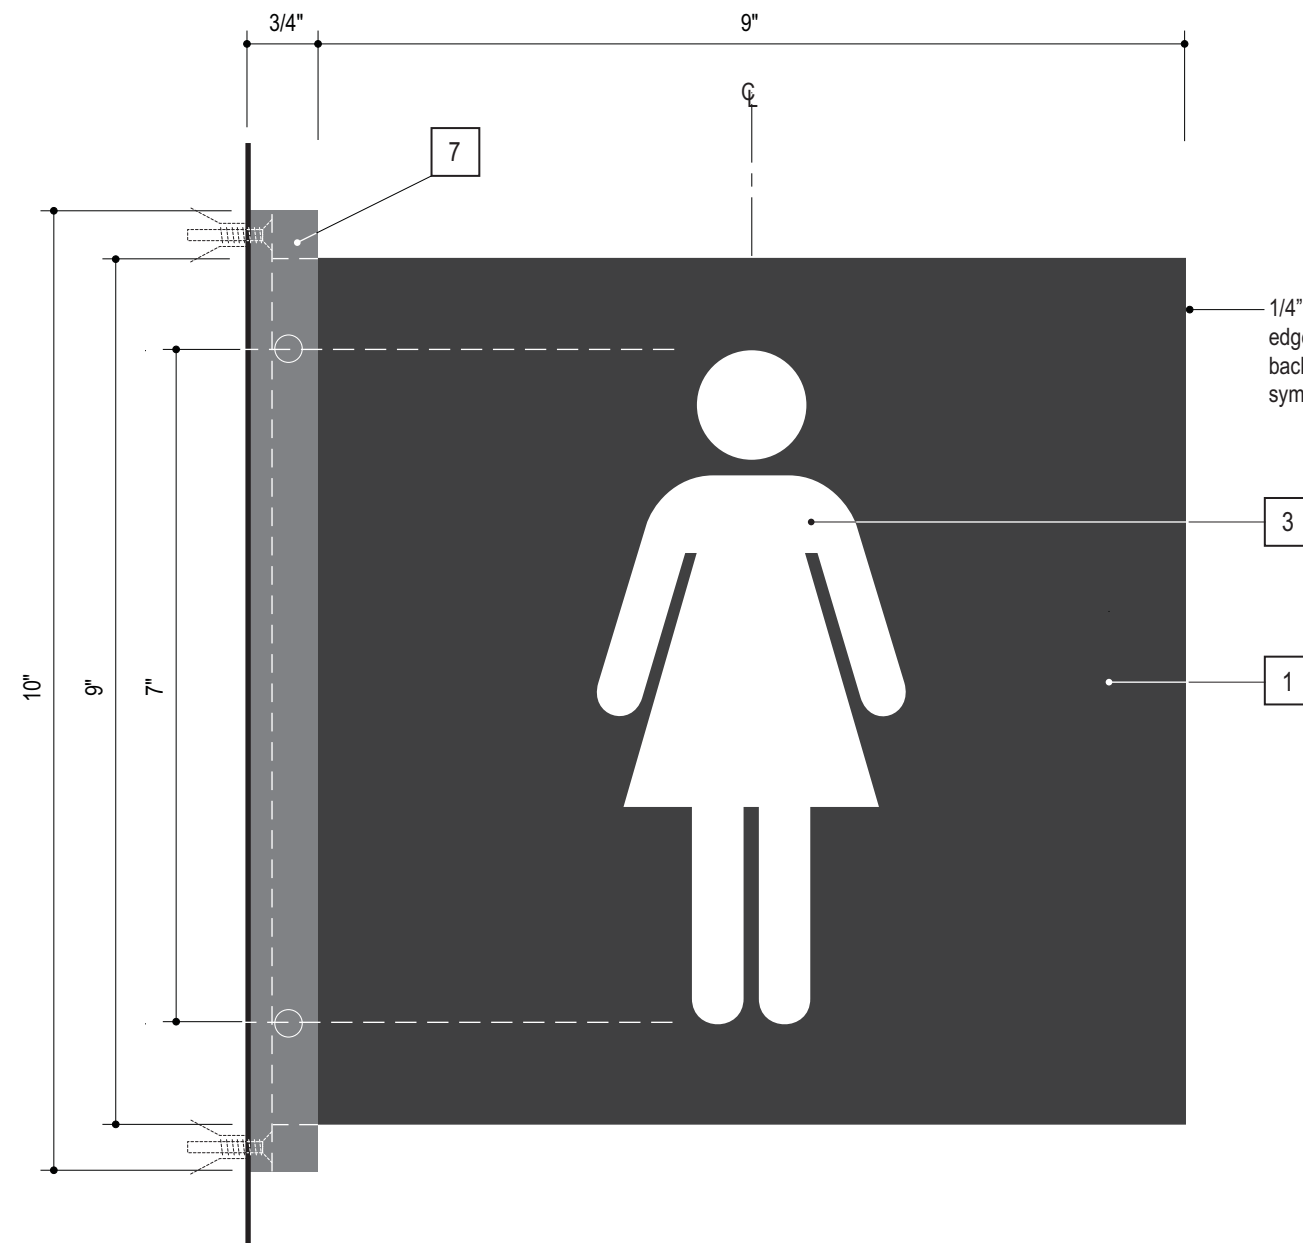

1/4" thick acrylic sanded edges. Surface painted background and 3M vinyl symbol.

3 Symbol on both sides

1

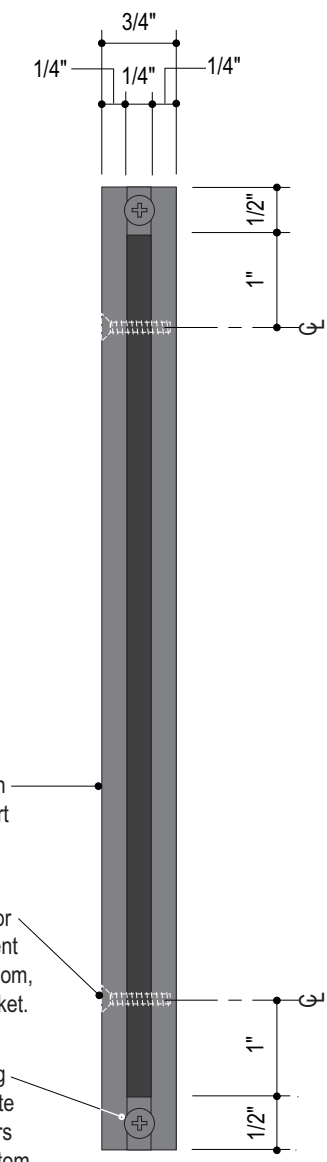


Aluminum bracket with milled channel to insert acrylic graphic panel.

Drill and tap bracket for countersunk attachment screws at top and bottom, painted to match bracket.

Countersunk mounting screws with appropriate expansion wall anchors located at top and bottom of bracket.

GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

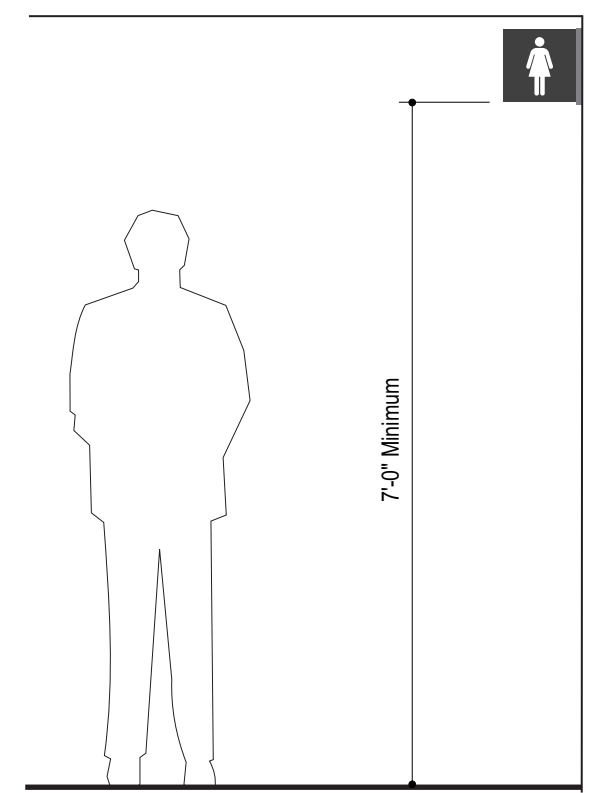


ELEVATION | HALF SIZE

SIDE VIEW | HALF SIZE


LOCATION ELEVATION | 1/2"=1'-0"

GENERAL NOTES:


1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille).
4. An inverted "L" shall precede all numbers in Braille.

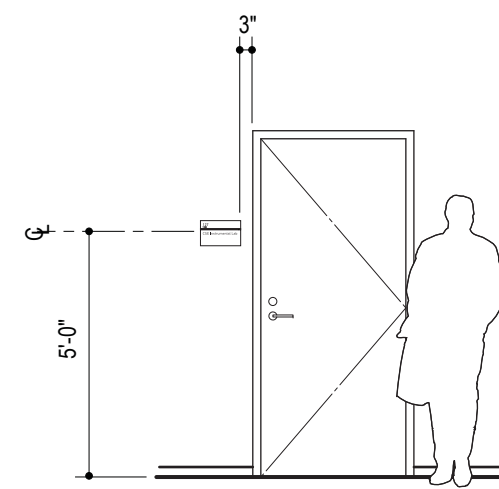

LOCATION ELEVATION | 1/4"=1'-0"

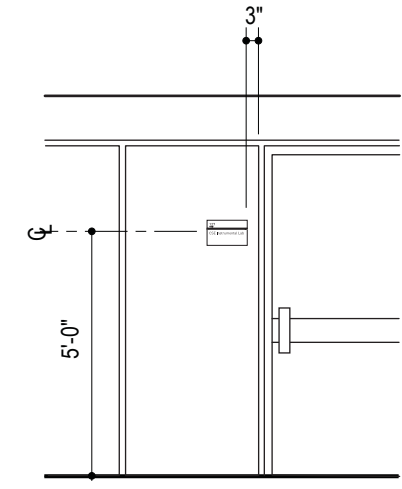

ALTERNATE GLASS MOUNTING | 1/4"=1'-0"

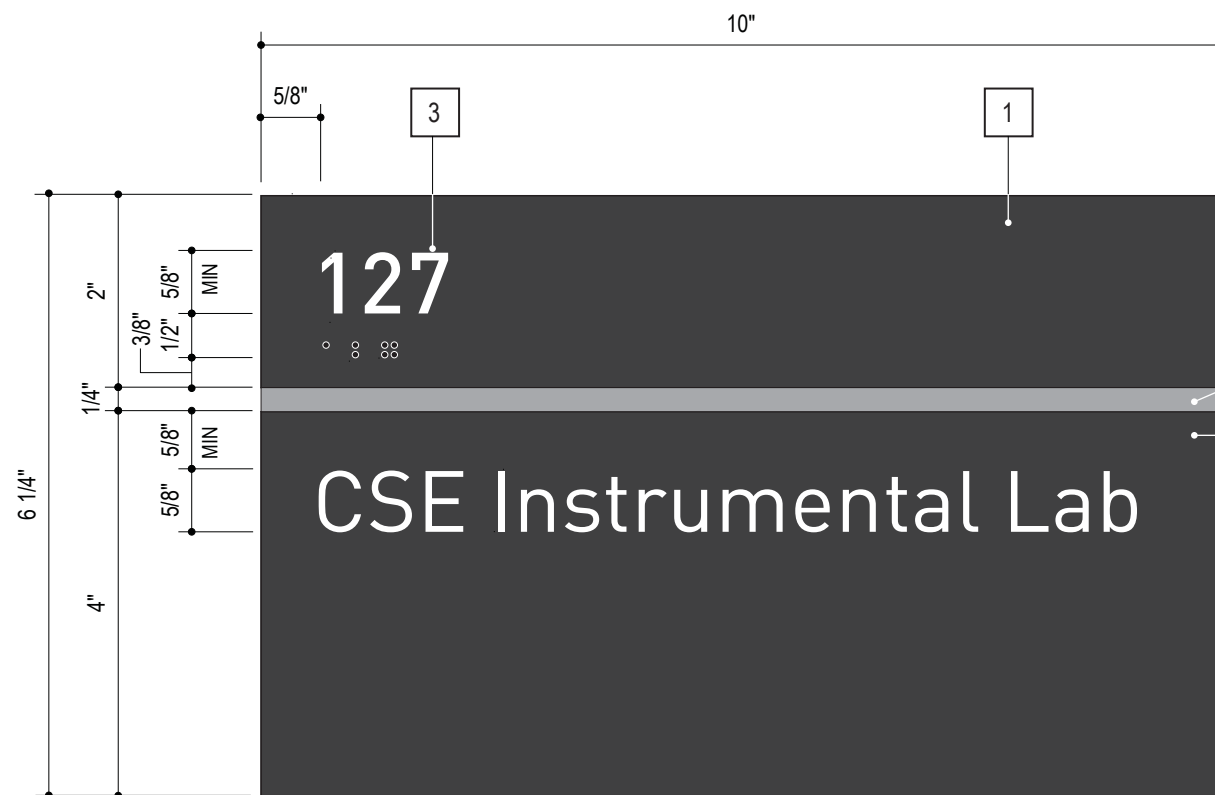


ELEVATION | HALF SIZE

1/4" thick photopolymer etched panel with 1/32" raised copy, California grade 2 braille.


1/4" x 1/4" square aluminum bar raised 1/8" above etched background and eased edges. Attached with concealed fasteners threaded and taped from back light sandblast finish.

Separate changeable bottom panel 1/16" thick New Hermes Gravoply II panel laminated to 1/8" acrylic panel. Copy to be engraved and panel sides to be painted to match slate gray.

1/16" thick acrylic backer panel permanently mounted to wall with 3M VHB tape and silicone. Paint sides to match adjacent sides.

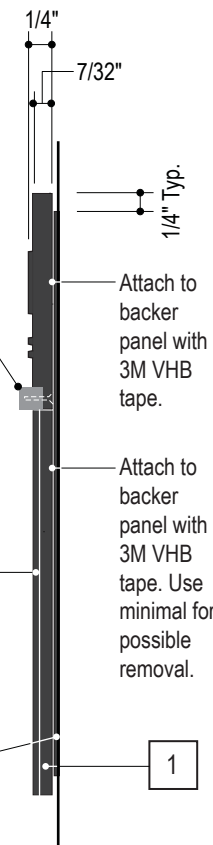

SIDE VIEW | HALF SIZE

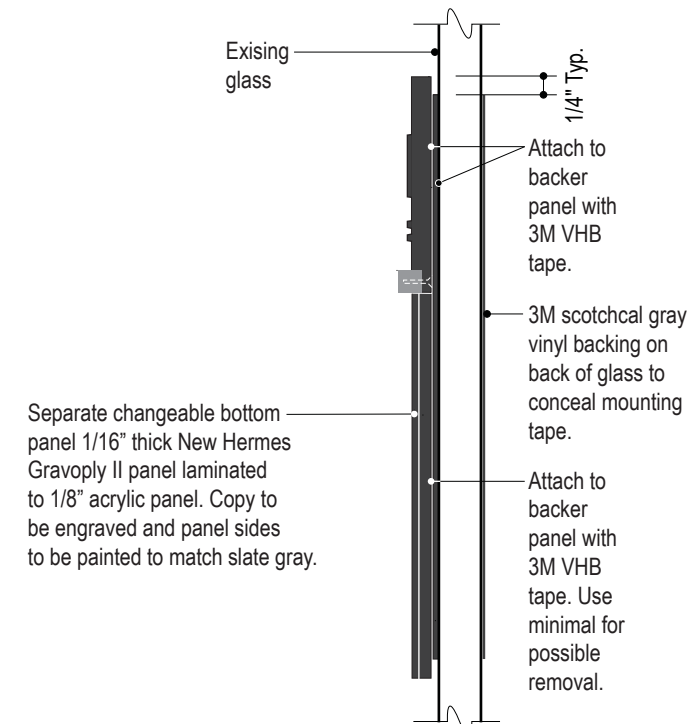

SIDE VIEW (GLASS MOUNT) | HALF SIZE


Updated 11/02/09

SUPERSEDED


**Refer to INTERIOR SIGNAGE PROGRAM for
Multidisciplinary Research Building (MRB)**

GENERAL NOTES:


1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille)
4. An inverted "L" shall precede all numbers in Braille.

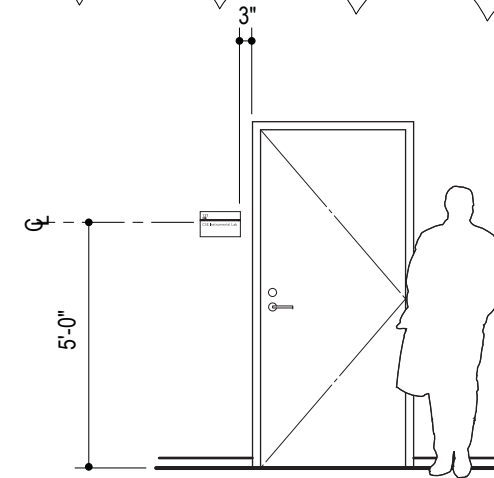


LOCATION ELEVATION | 1/4"=1'-0"

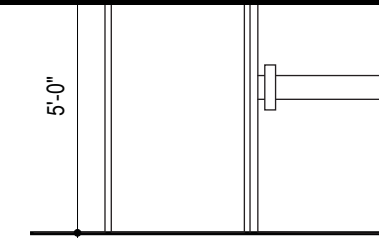


ALTERNATE GLASS MOUNTING | 1/4"=1'-0"

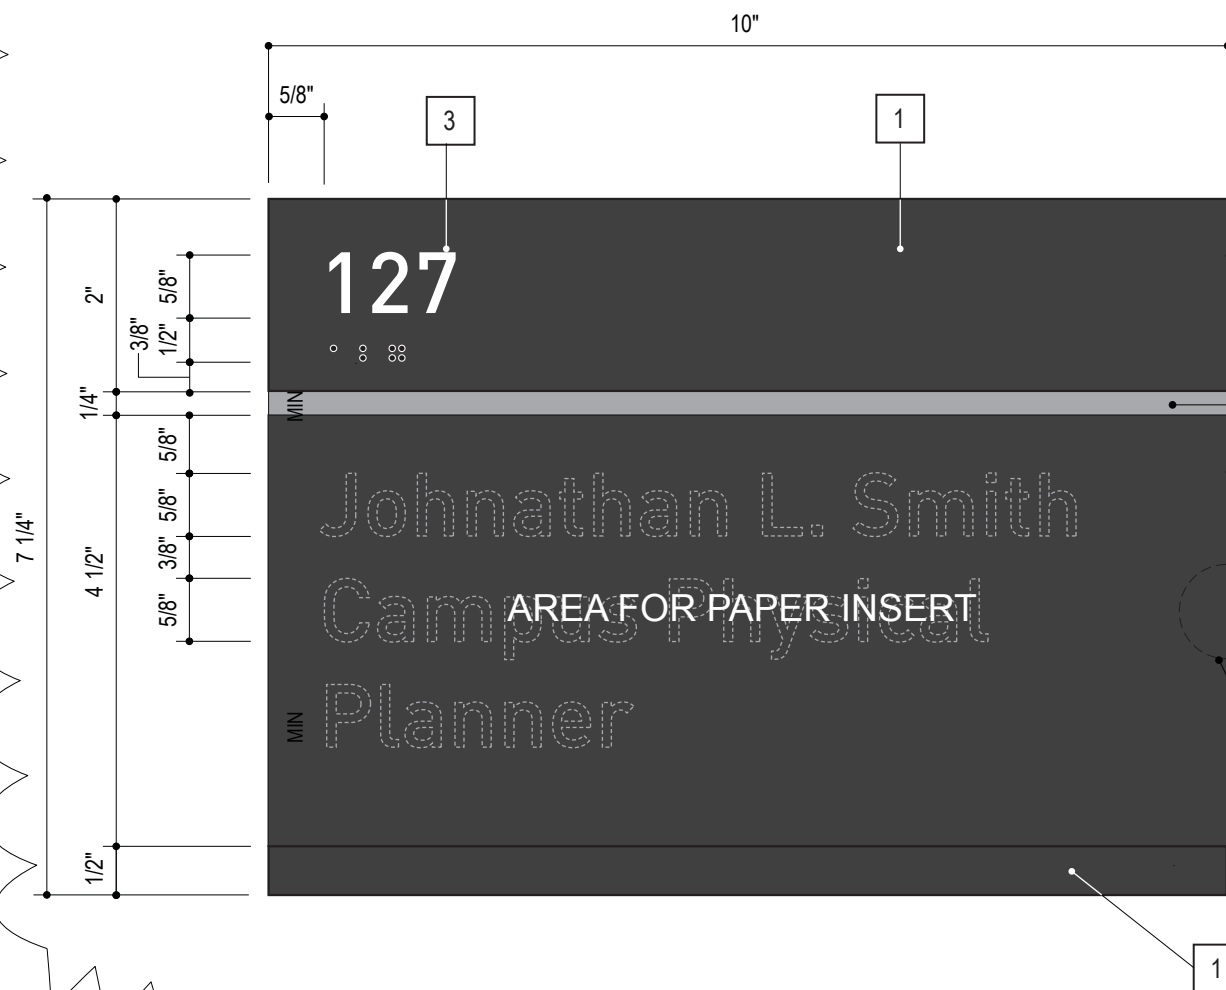


ELEVATION | HALF SIZE

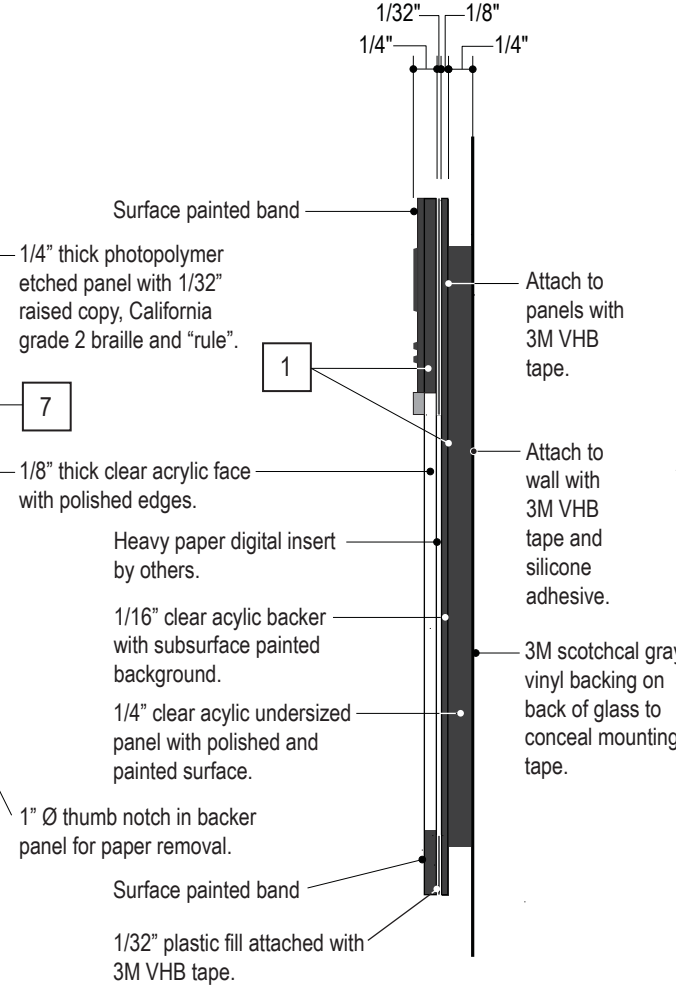

SIDE VIEW | HALF SIZE

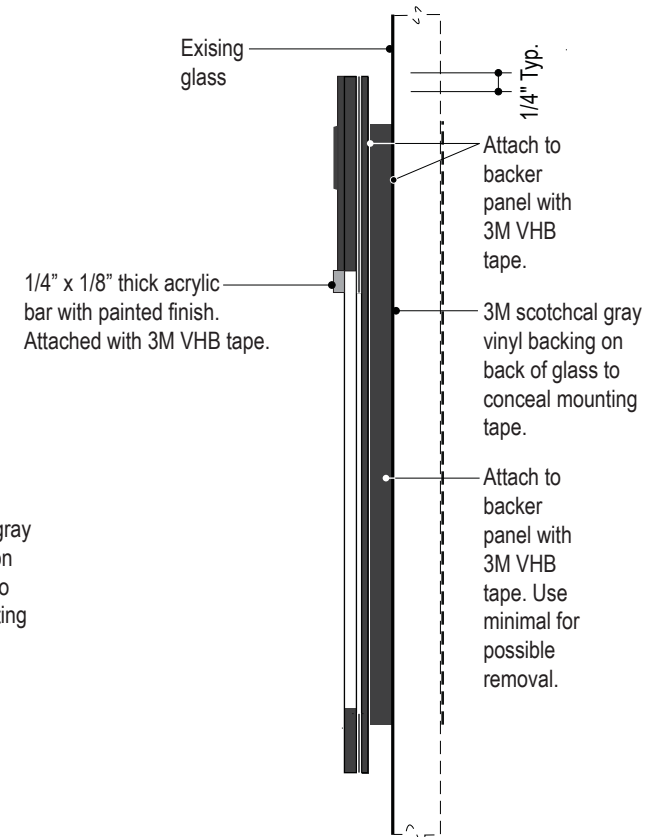

SIDE VIEW (GLASS MOUNT) | HALF SIZE

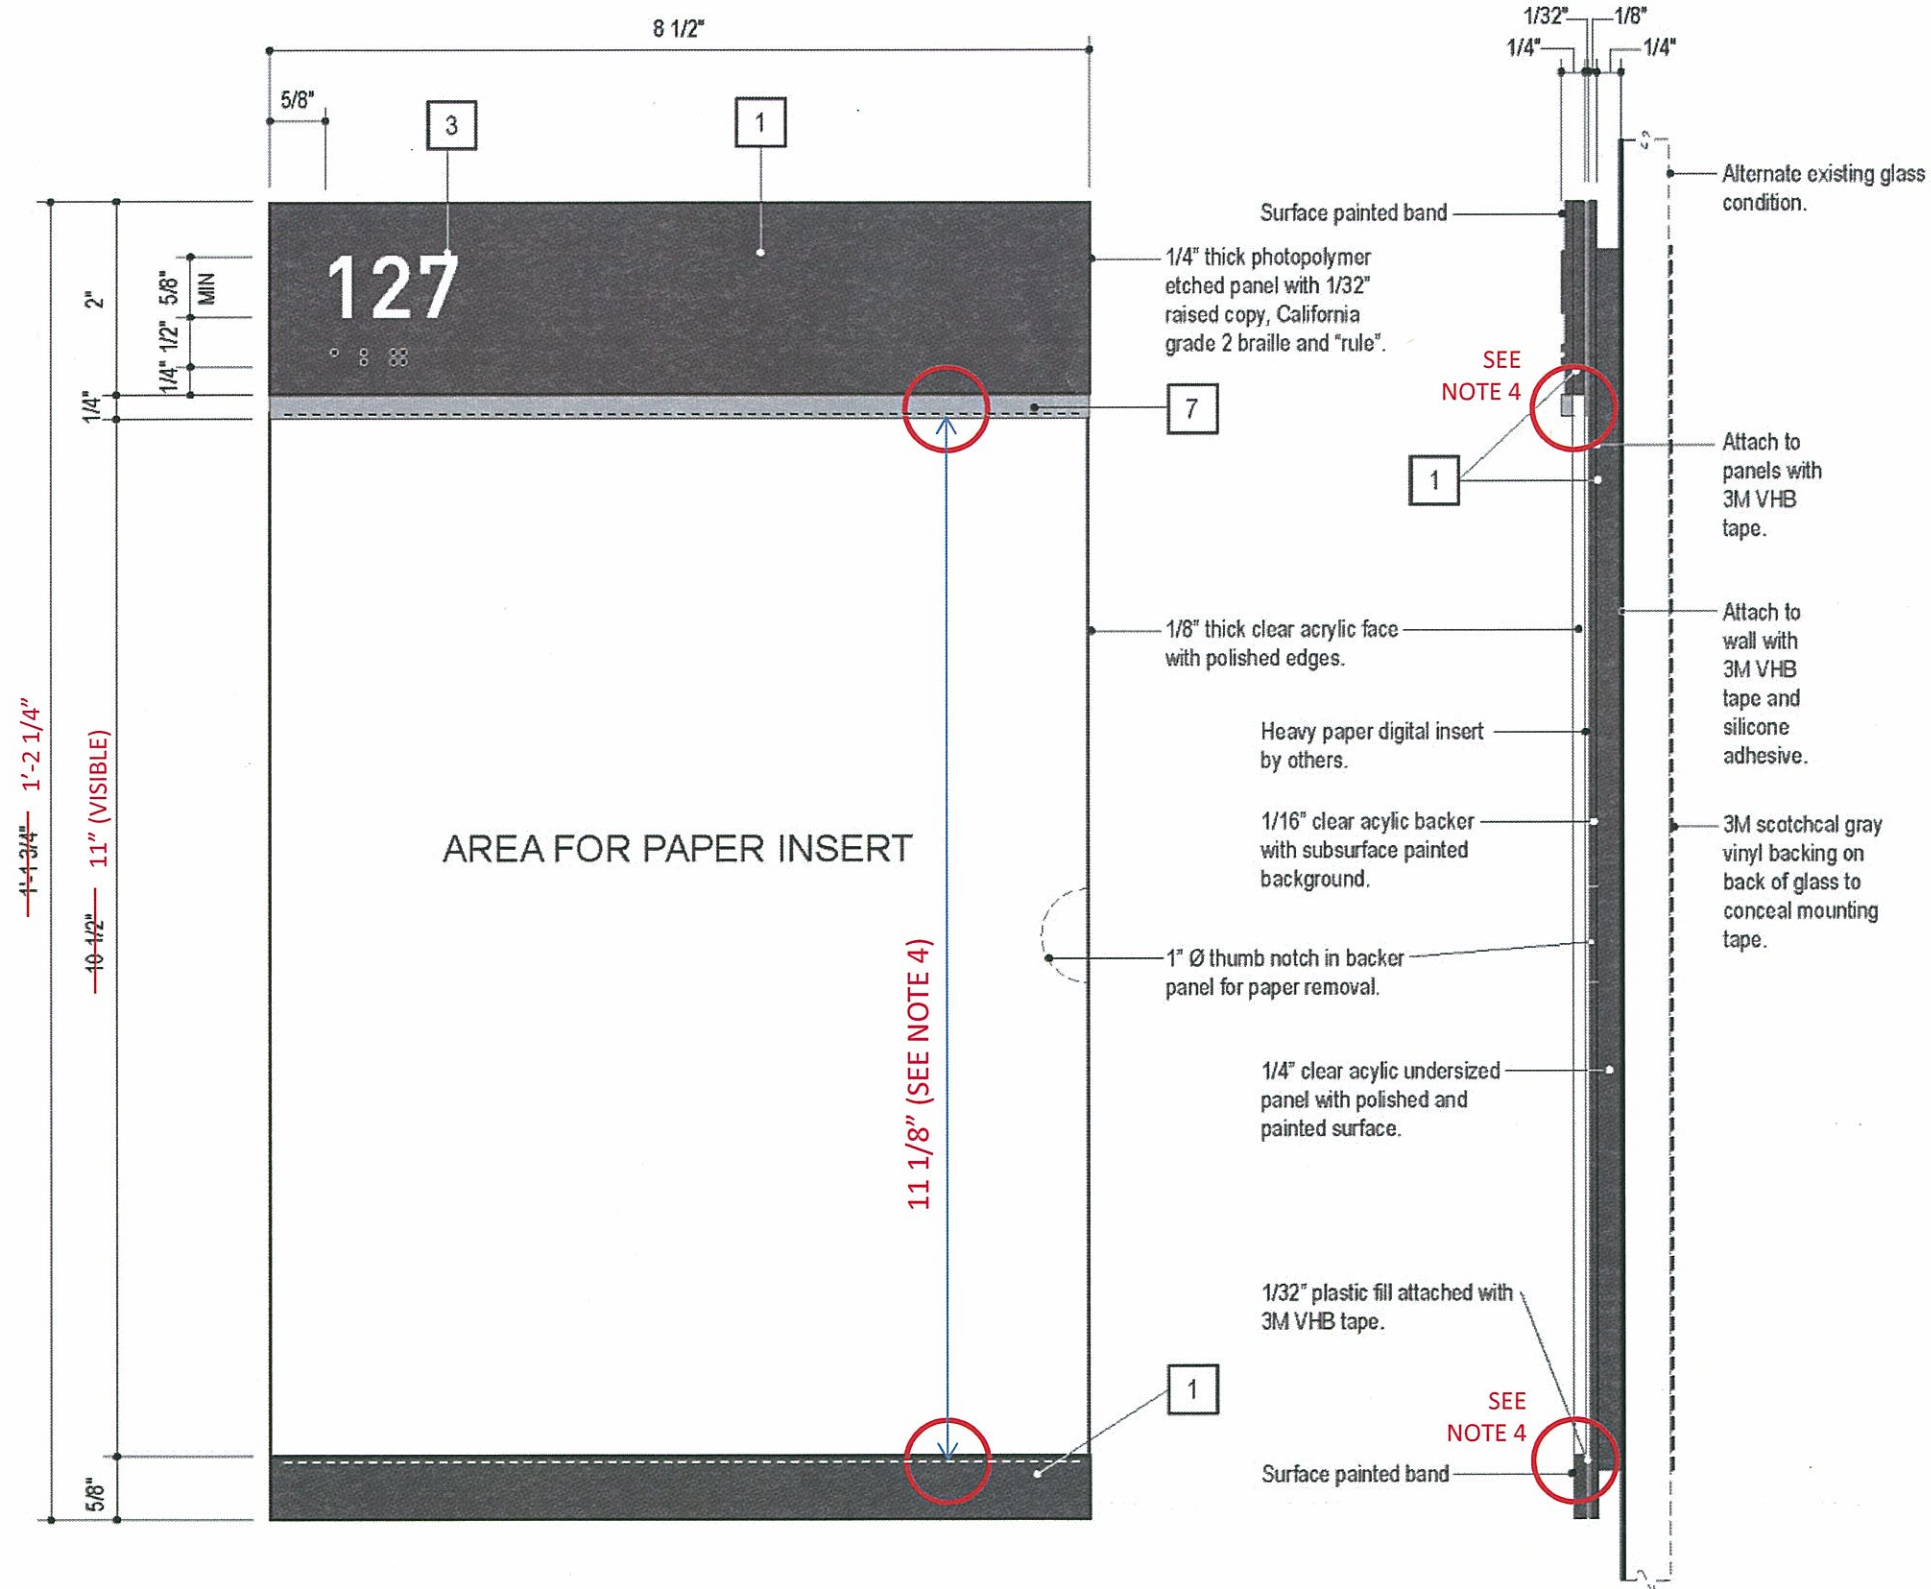

ELEVATION HALF SIZE


SIDE VIEW HALF SIZE

SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)


appropriate attachment method as per condition.

- 3. Braille shall be Calif Grade 2 (Contracted Braille).
- 4. 1/16" tolerance provided at top and bottom for paper insert

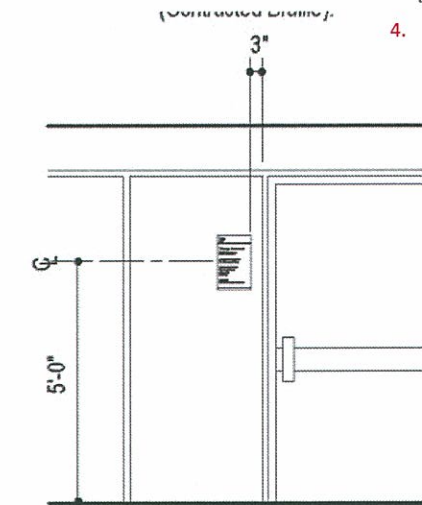

- 5. An inverted "L" shall precede all numbers in Braille.

ALTERNATE GLASS MOUNTING 1/4"=1'-0"

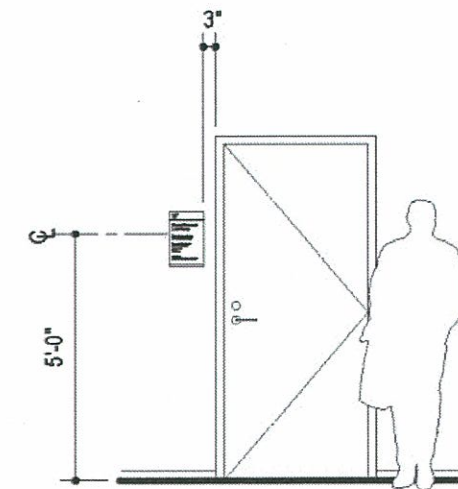


LOCATION ELEVATION 1/4"=1'-0"

CORRECTION TO CAMPUS SIGN PROGRAM
DRAWING 1.63X (REPLACES DRAWING 1.63)

AUTHORIZED BY:

Timothy Ralston
JULY 12, 2011

TIMOTHY RALSTON
ASSOCIATE VICE CHANCELLOR
CAPITAL RESOURCE MANAGEMENT
UNIVERSITY OF CALIFORNIA, RIVERSIDE

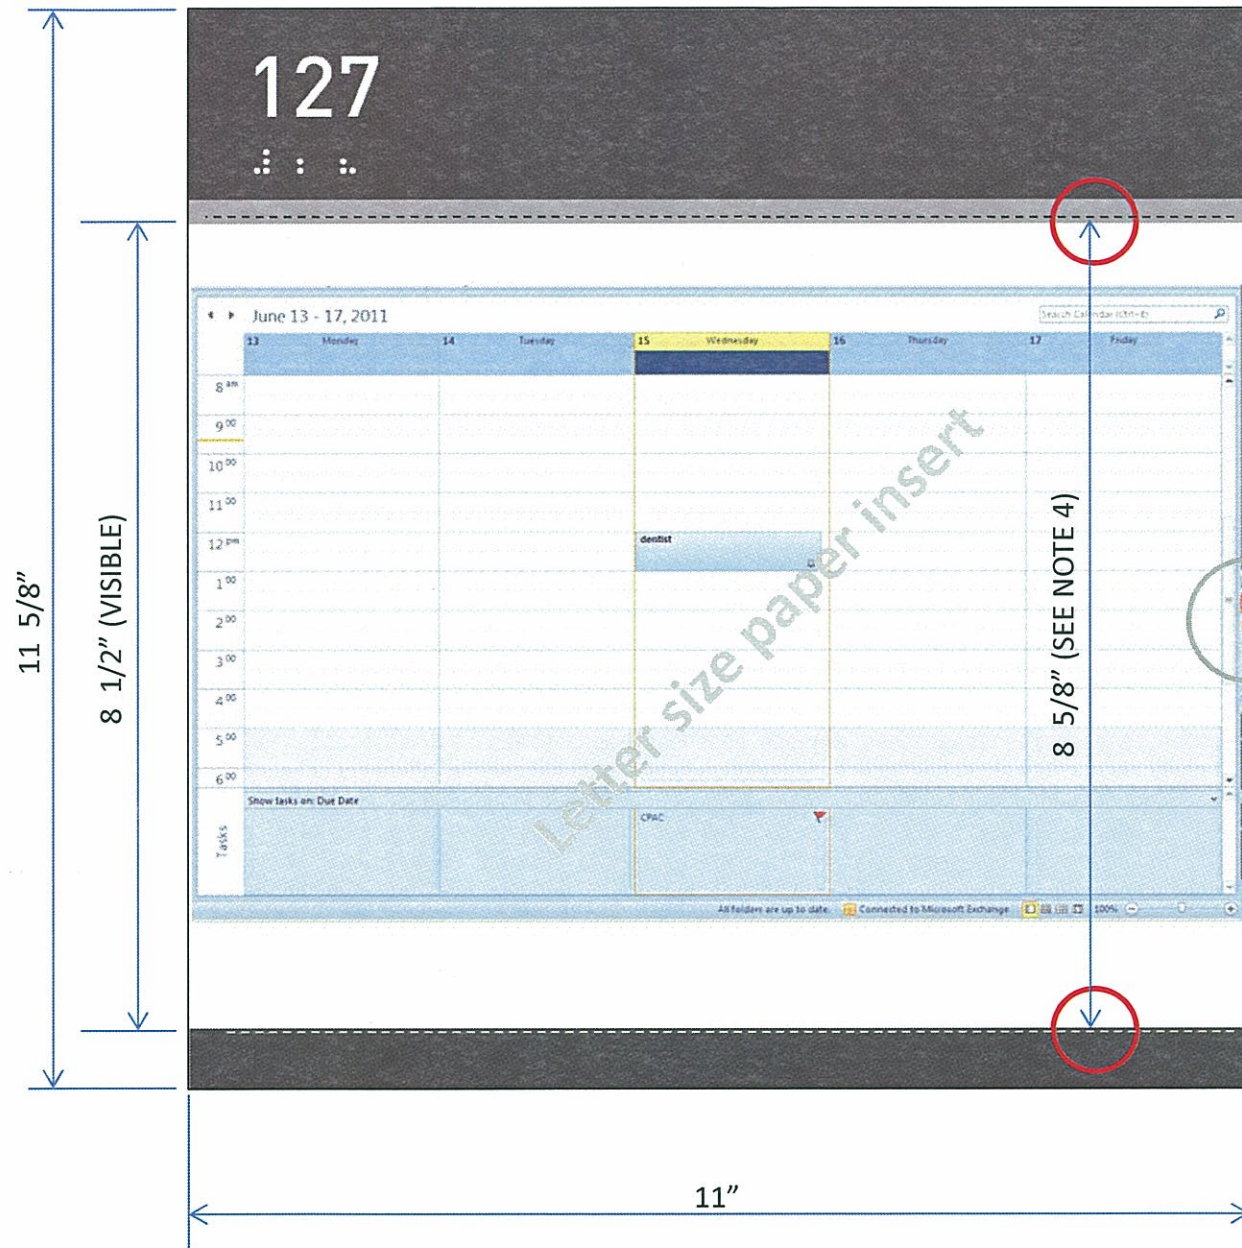

GENERAL NOTES:

1. This sign is to be fabricated identical to sign type B32 in all respects with the exception of the following:
 - a. Overall width will be 11"
 - b. Overall height will be 11 5/8"
2. For all additional details refer to DWG. 1.63X of the 2008 CAMPUS SIGN PROGRAM

ELEVATION | HALF SIZE

AMENDMENT TO CAMPUS SIGN PROGRAM
 DRAWING 1.63A FOR SIGN TYPE B32A

AUTHORIZED BY:

Timothy Ralston
 JULY 12, 2011



TIMOTHY RALSTON
 ASSOCIATE VICE CHANCELLOR
 CAPITAL RESOURCE MANAGEMENT
 UNIVERSITY OF CALIFORNIA, RIVERSIDE

GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille).
4. An inverted "L" shall precede all numbers in Braille.


SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)

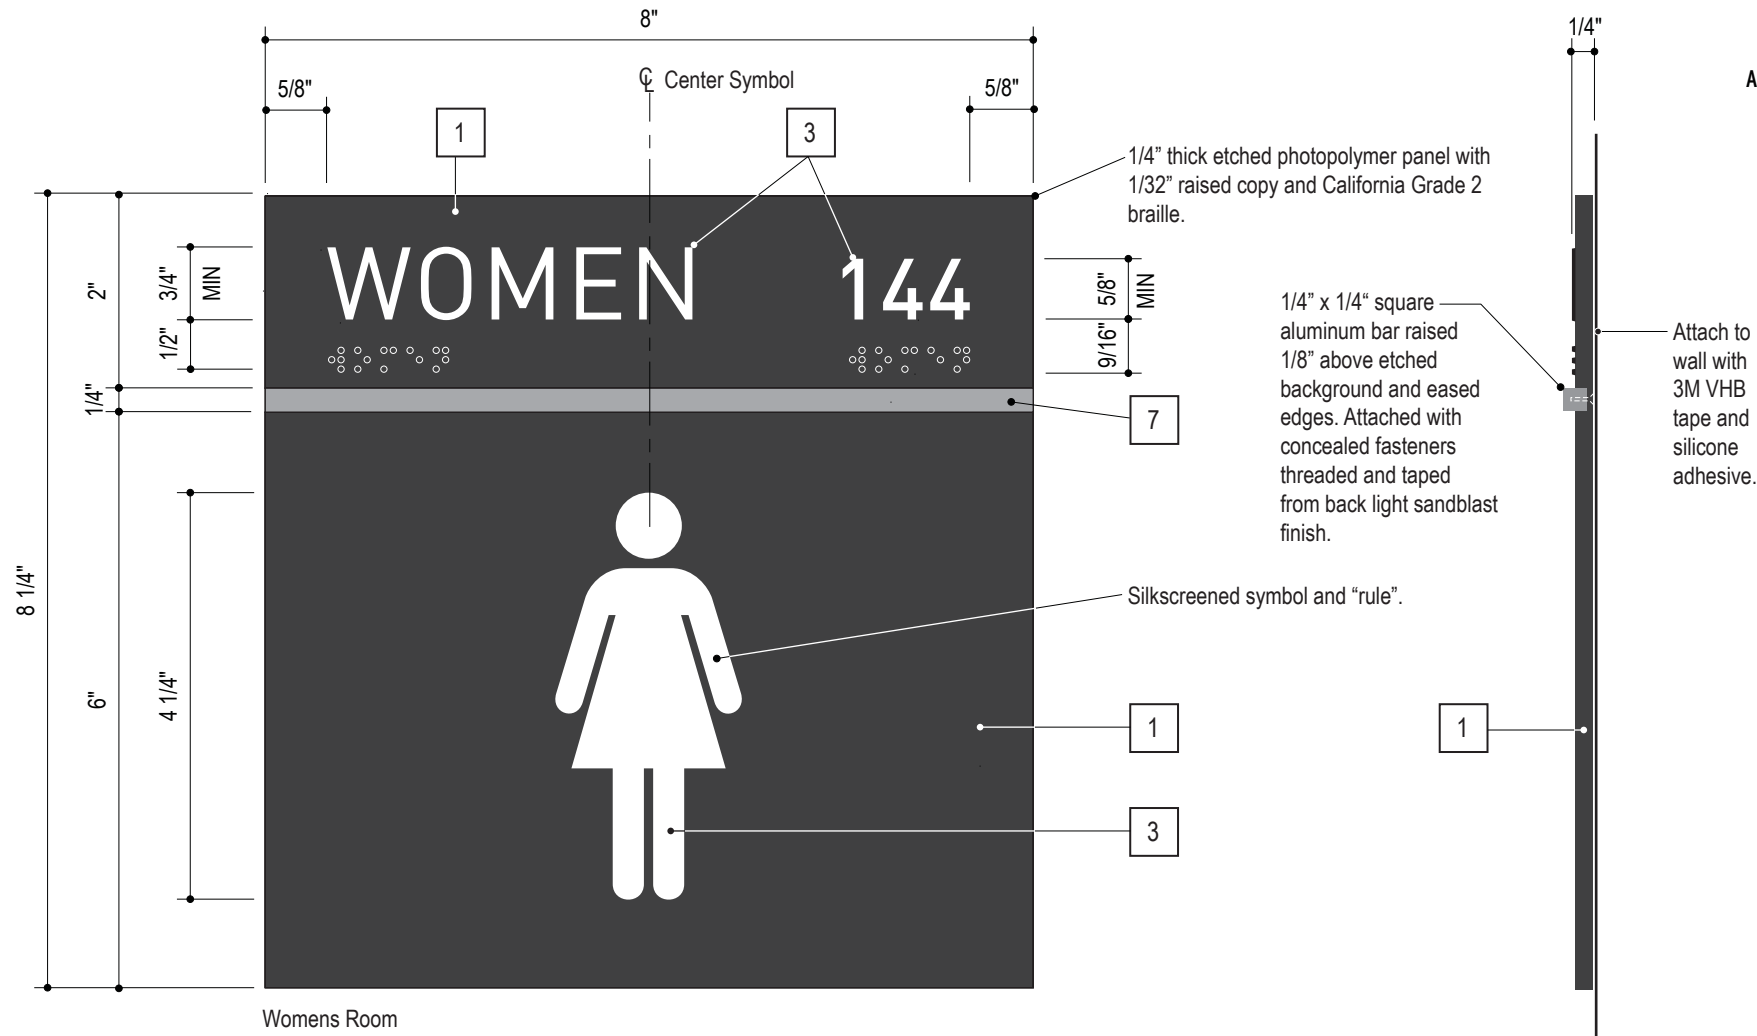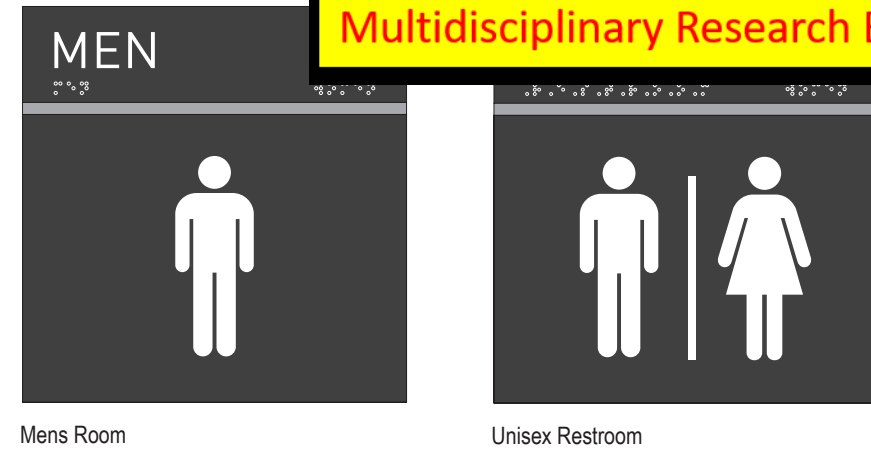


ADDITIONAL LAYOUTS

3"=1'-0"

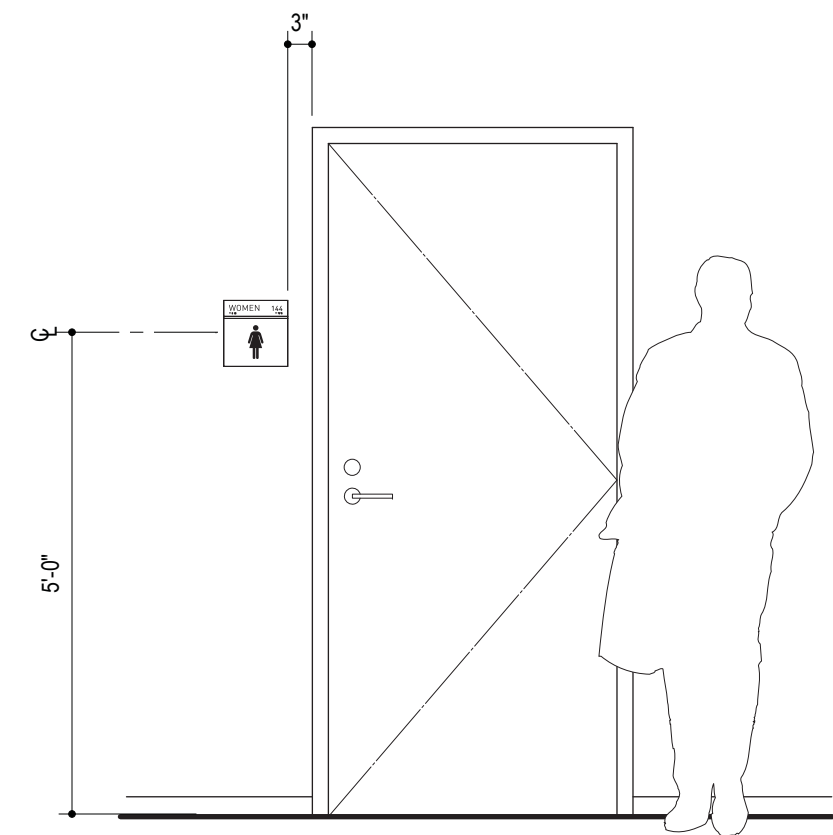


GENERAL NOTES:


1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

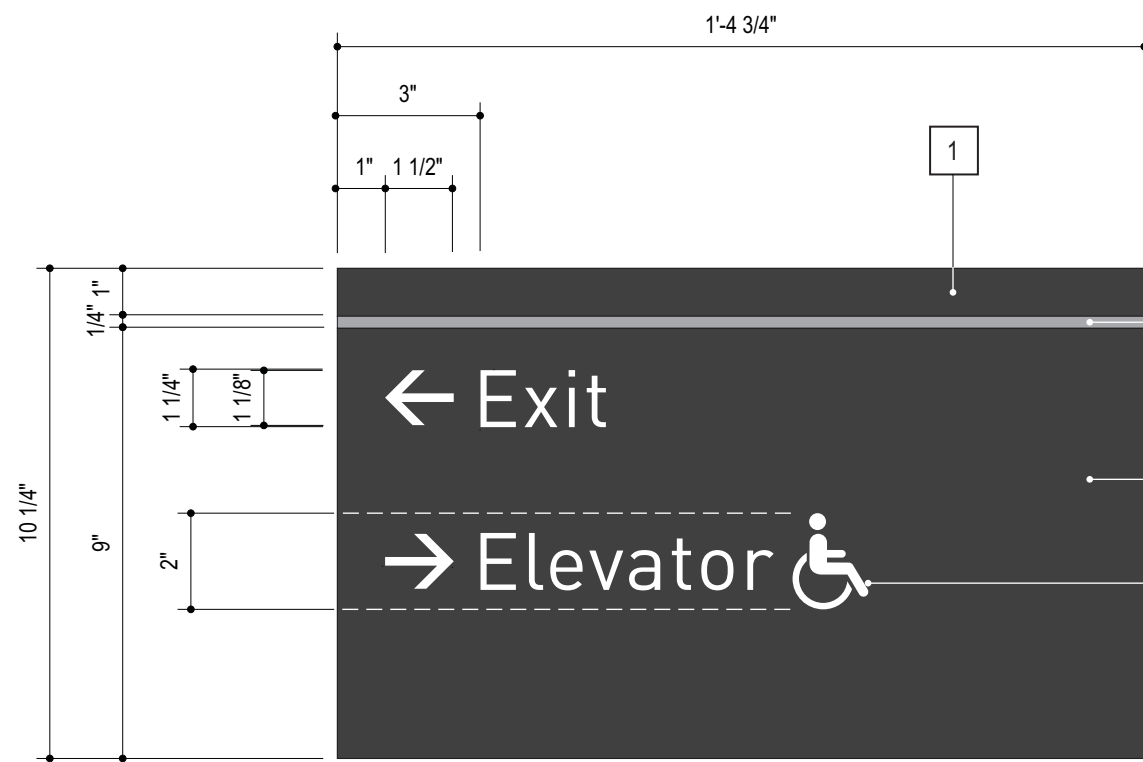

ELEVATION | 3"=1'-0"

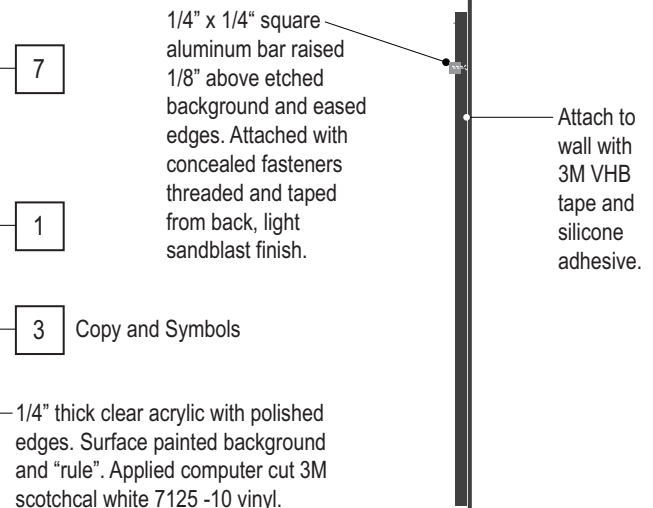





SIDE VIEW | 3"=1'-0"

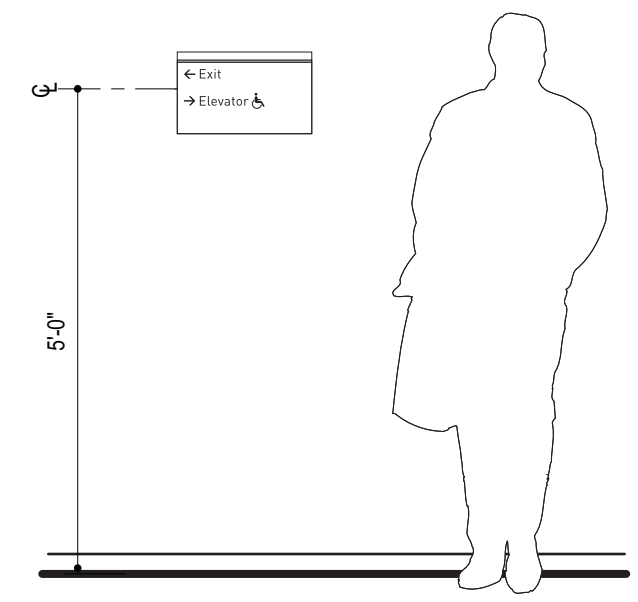

LOCATION ELEVATION | 1/2"=1'-0"


GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

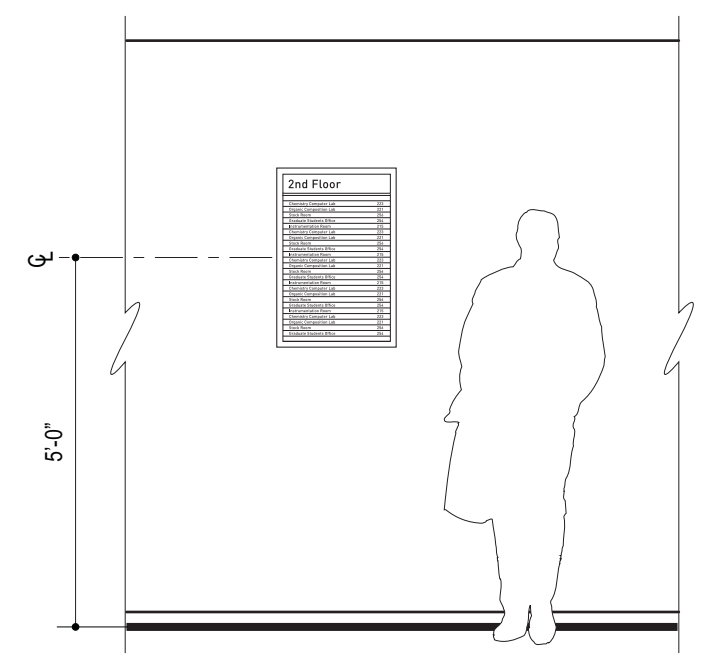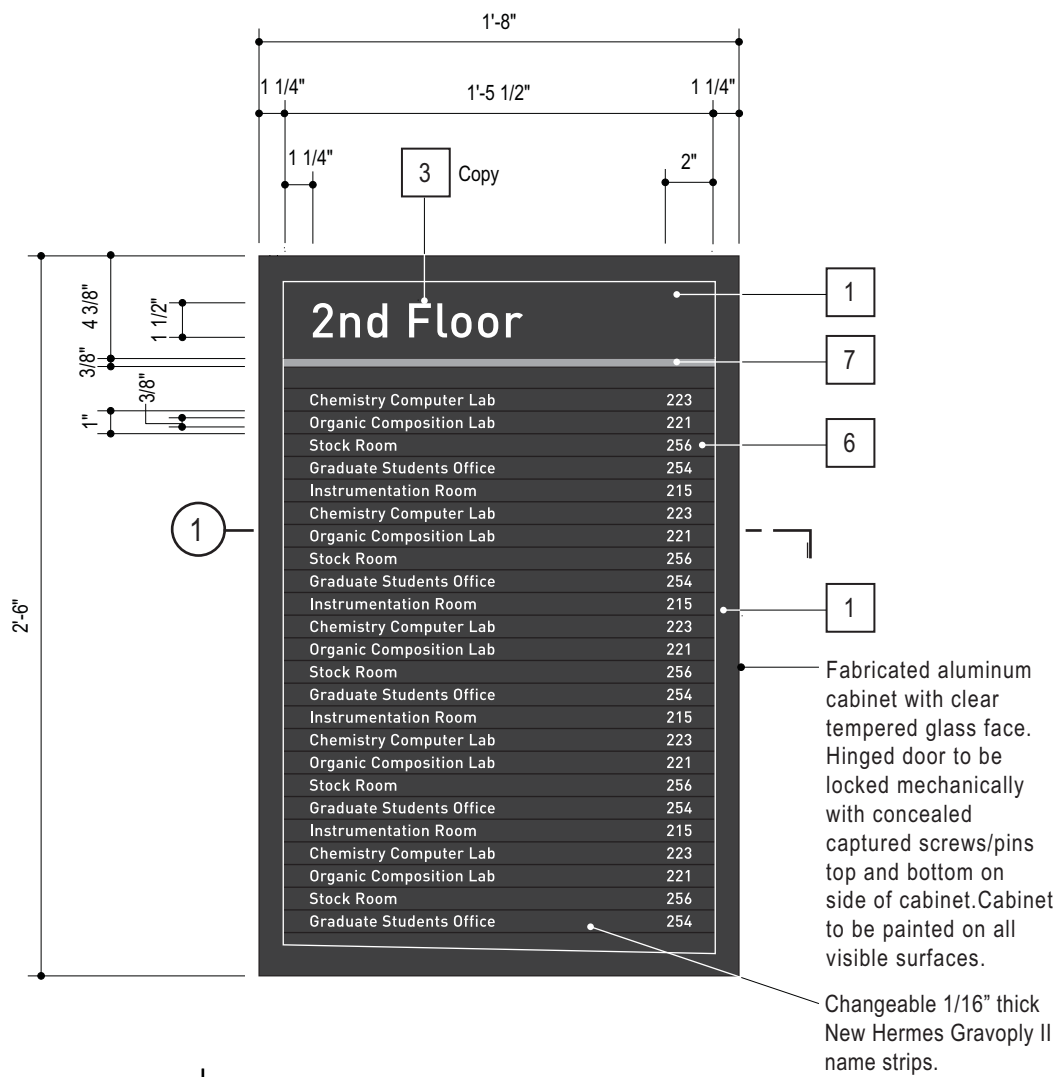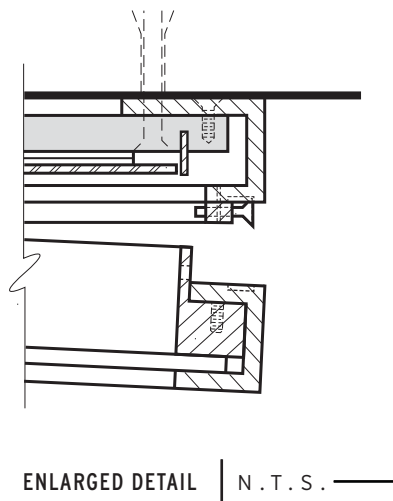
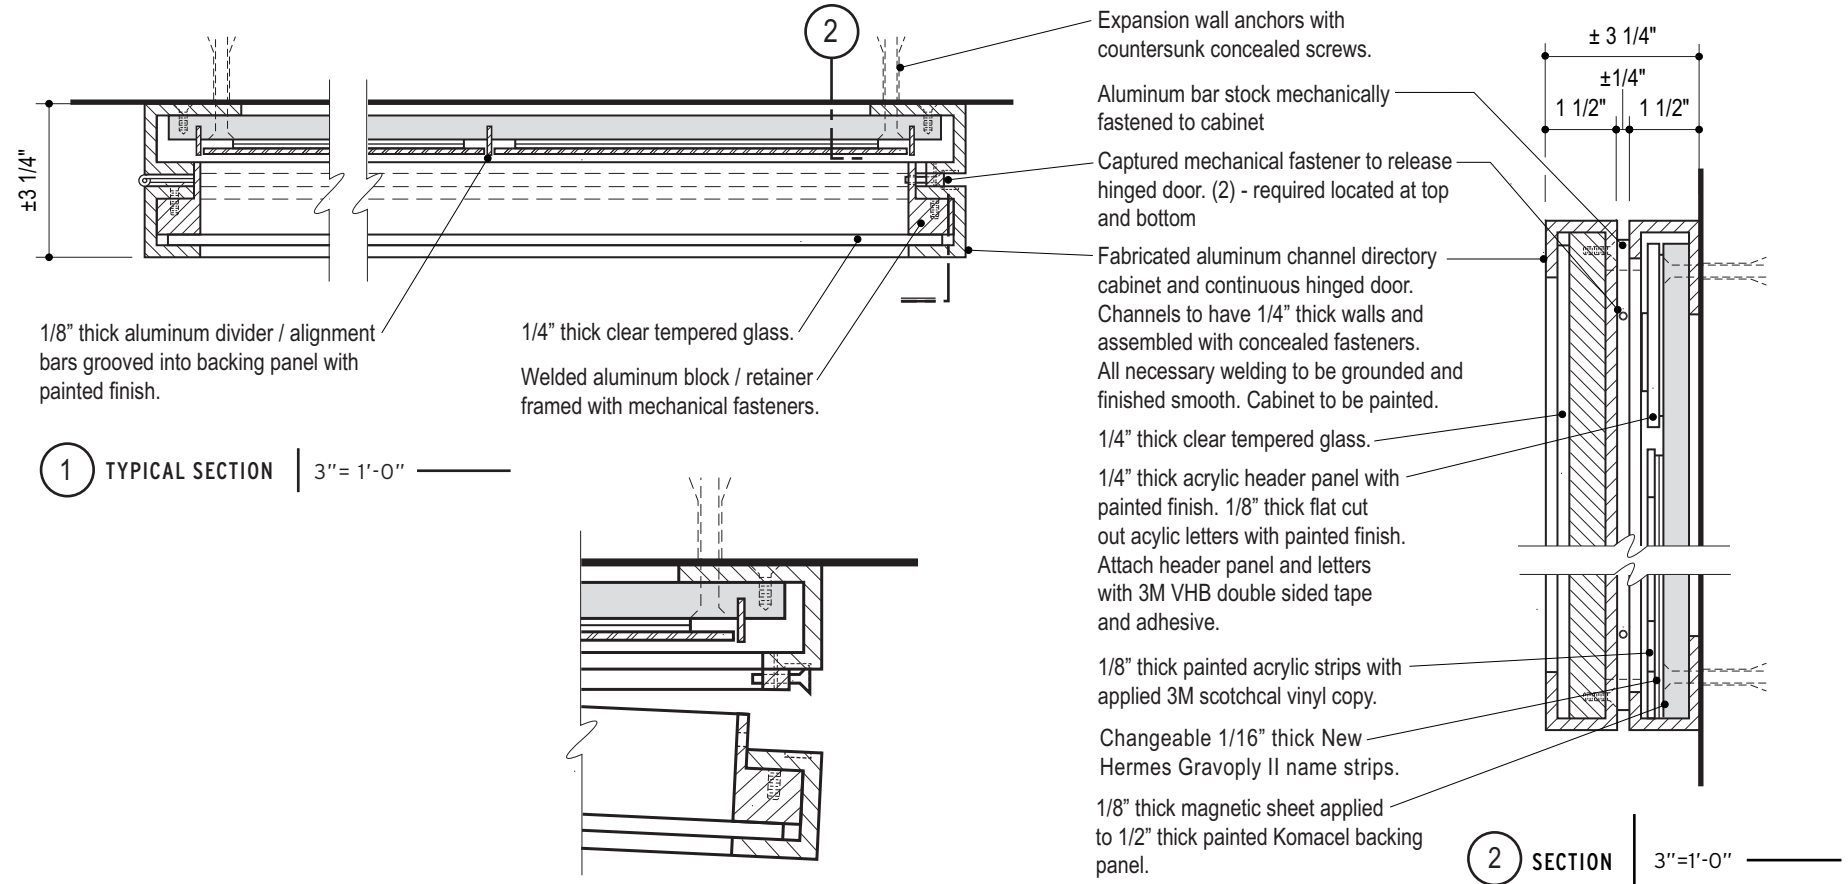


GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

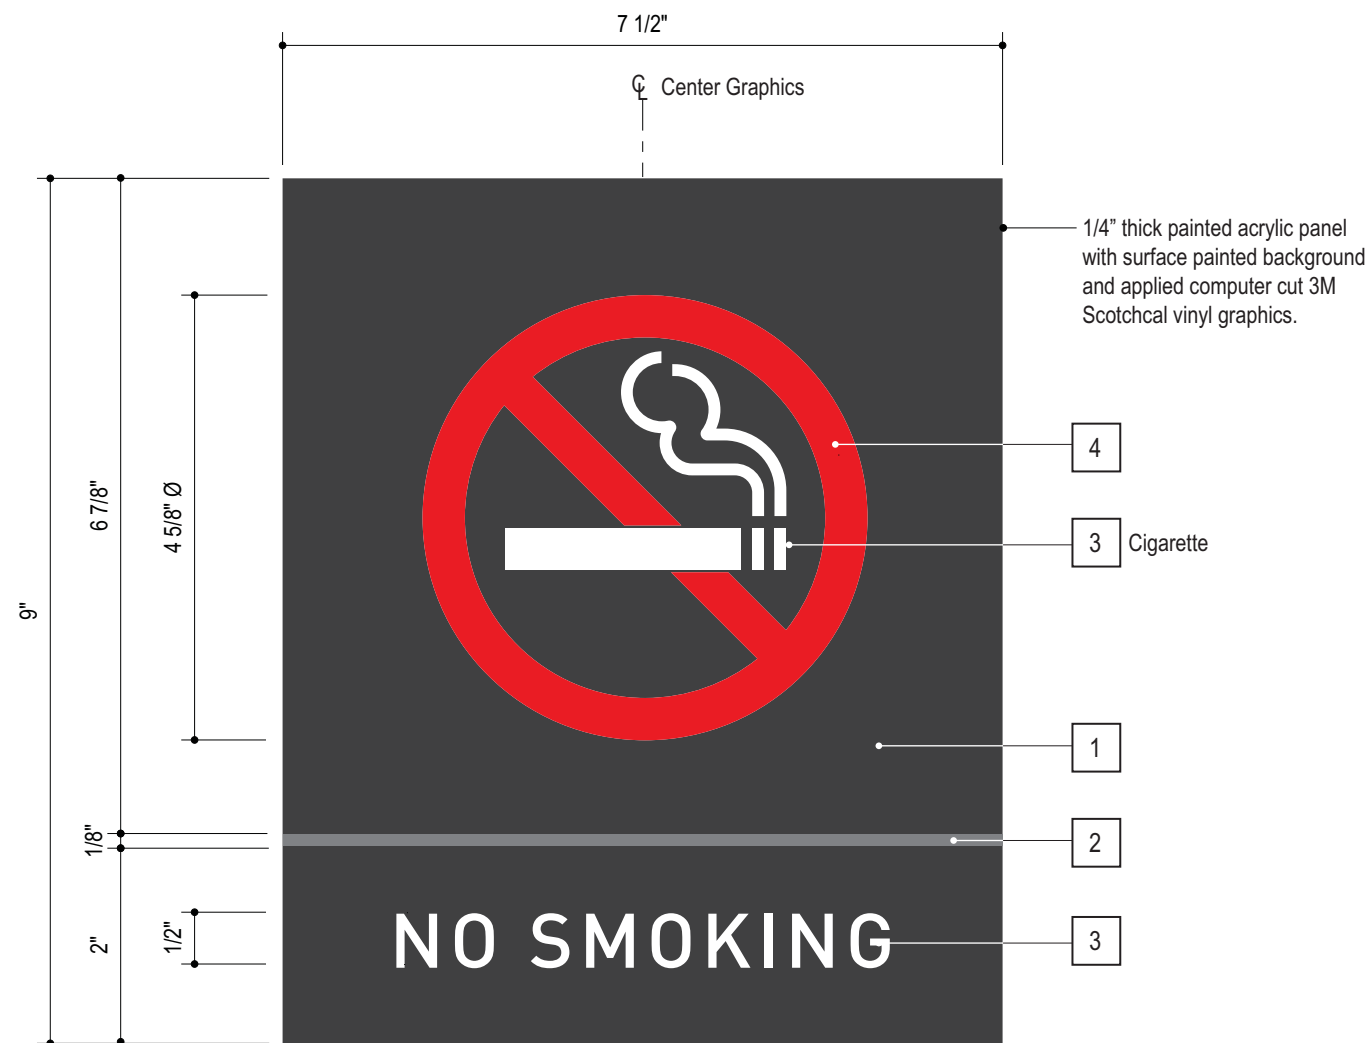

ELEVATION HALF SIZE

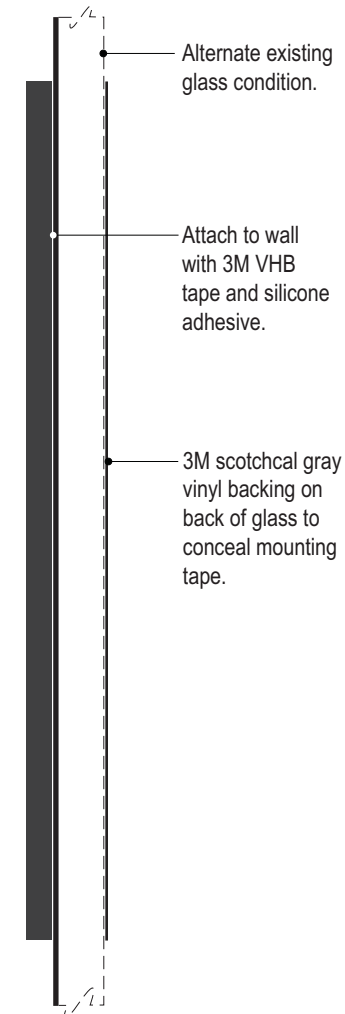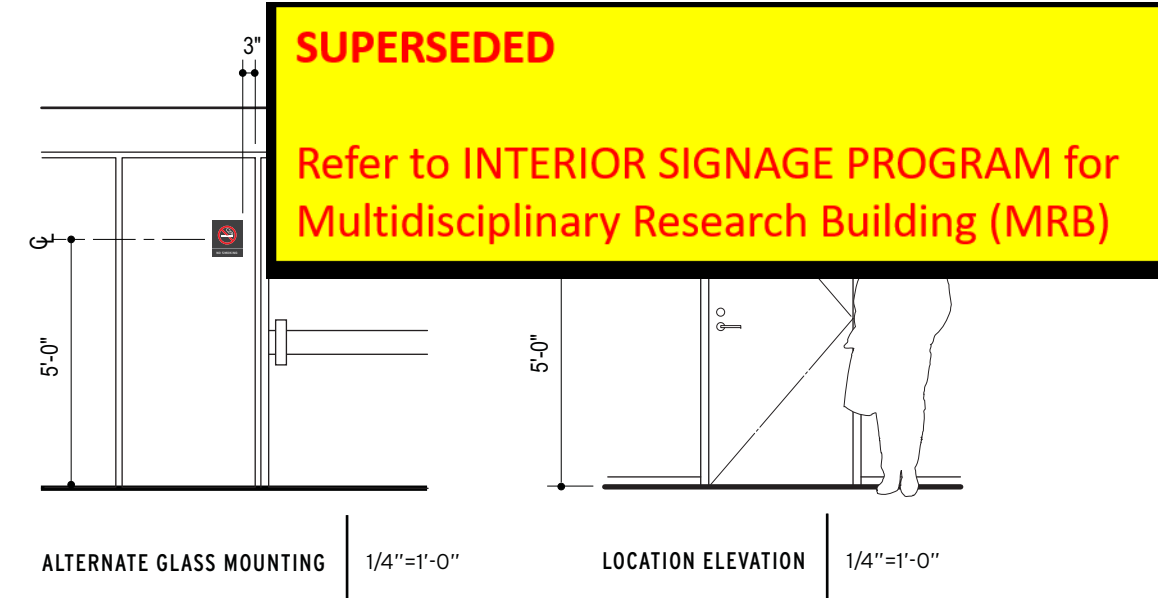



SIDE VIEW HALF SIZE





ADDITIONAL LAYOUTS HALF SIZE

GENERAL NOTES:

1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

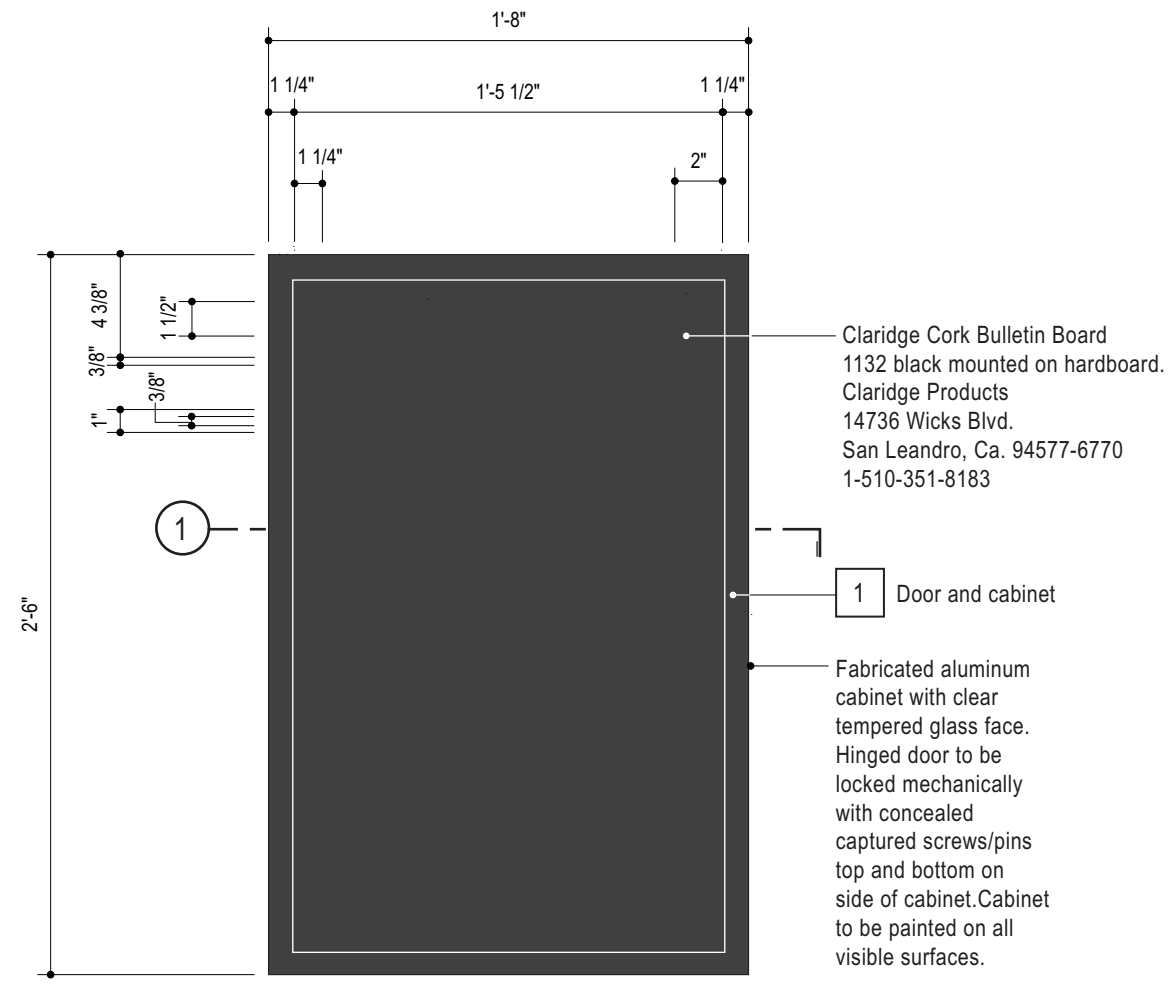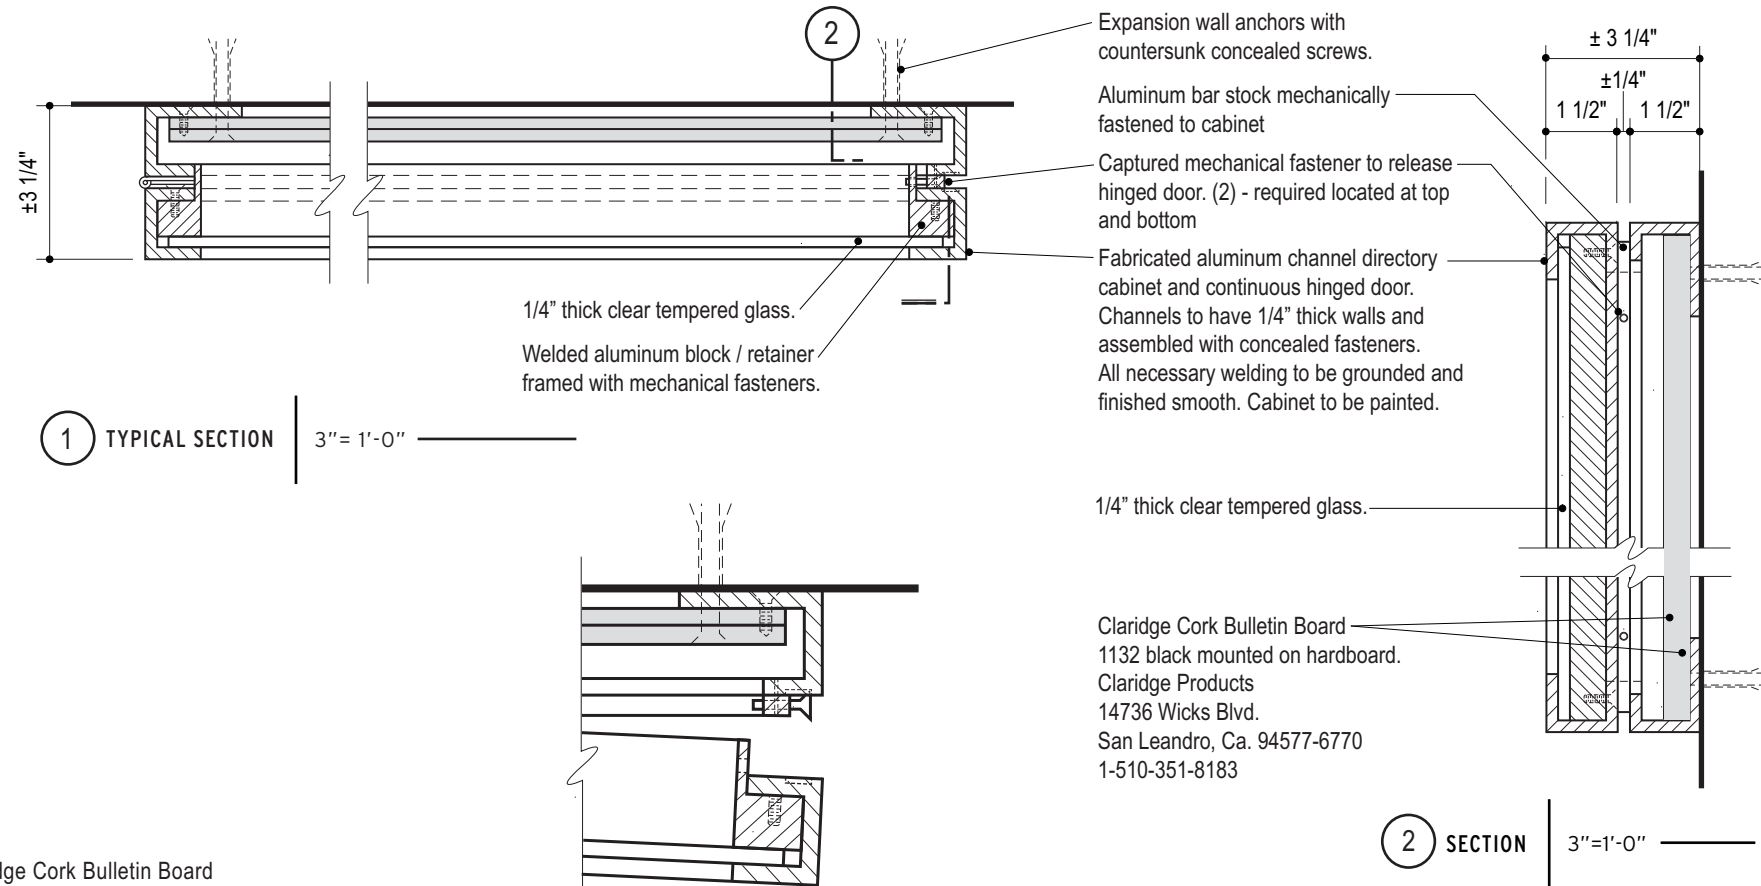

ELEVATION 1 1/2"=1'-0"

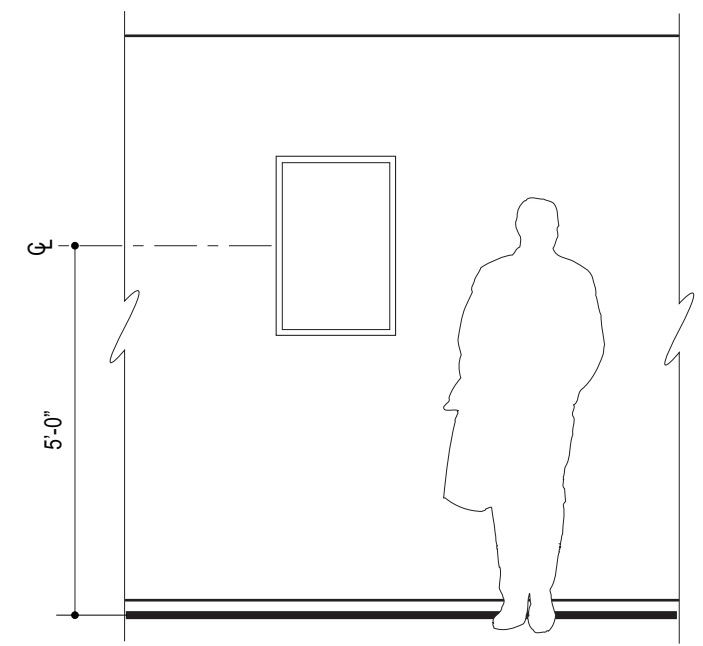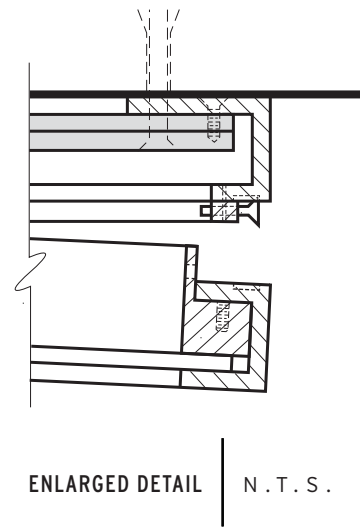


LOCATION ELEVATION 3/8"=1'-0"


SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)


2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille).
4. An inverted "L" shall precede all numbers in Braille.

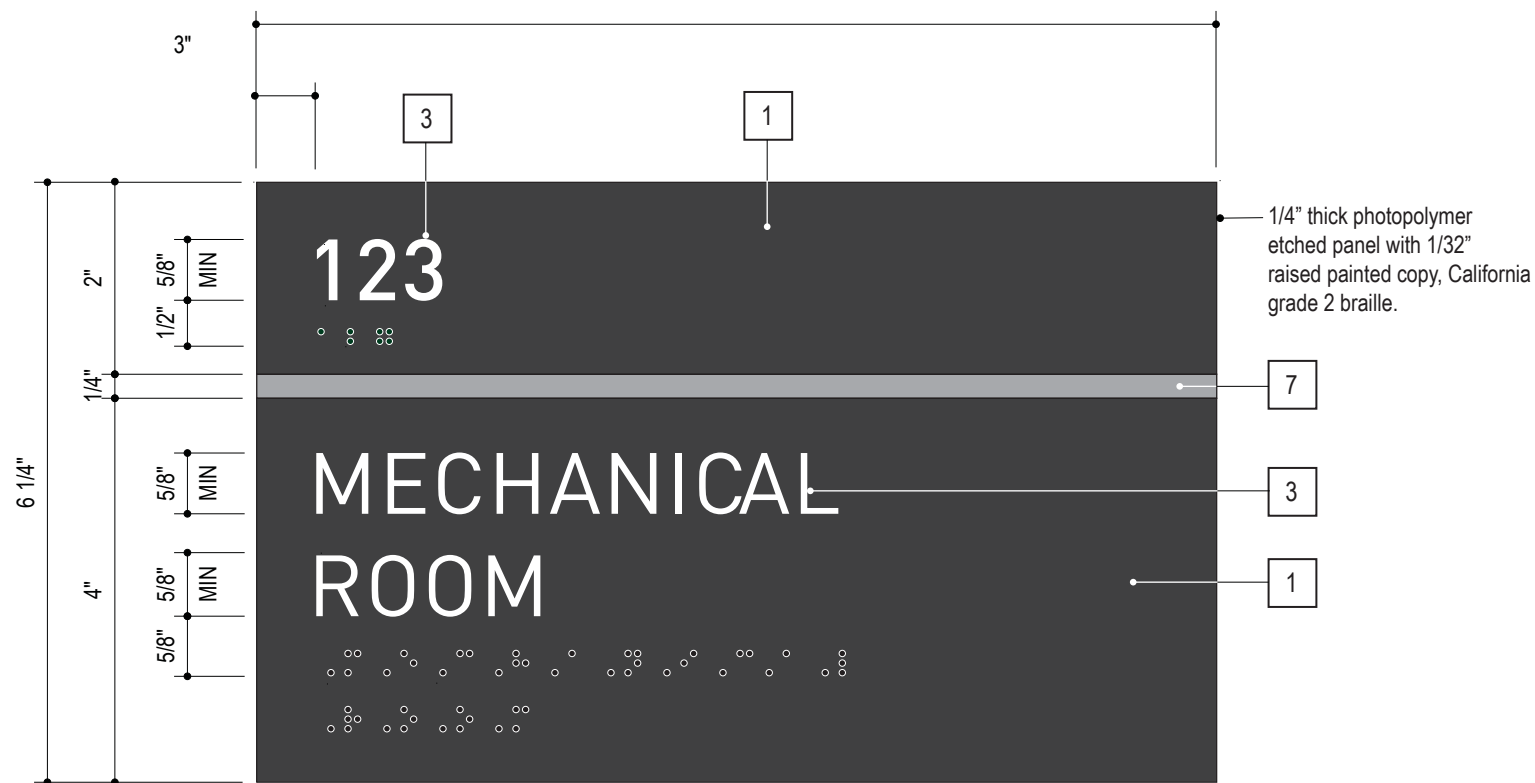

ELEVATION | HALF SIZE

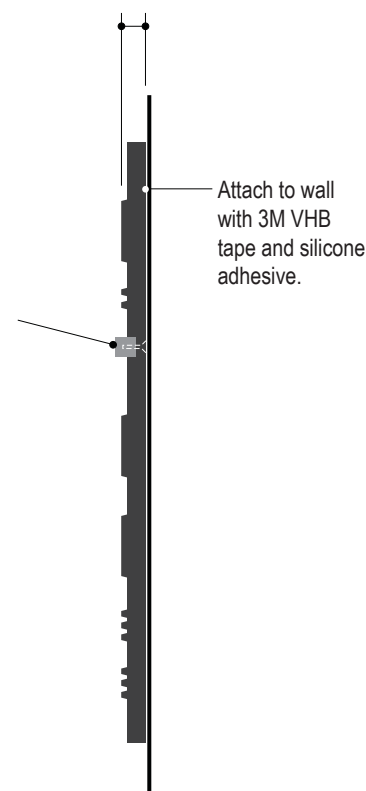


SIDE VIEW | HALF SIZE

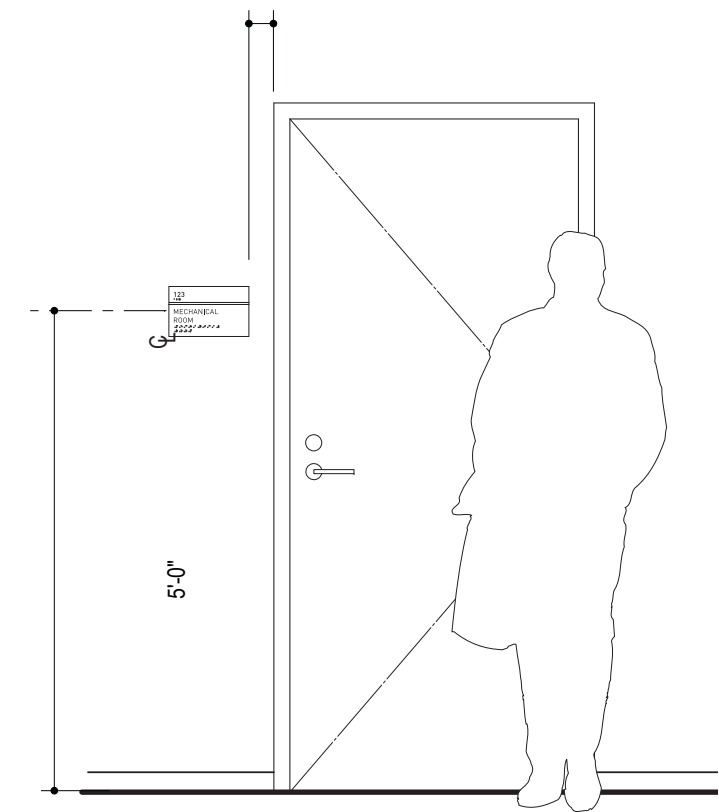


LOCATION ELEVATION | 1/2"=1'-0"

SUPERSEDED
 Refer to INTERIOR SIGNAGE PROGRAM for
 Multidisciplinary Research Building (MRB)


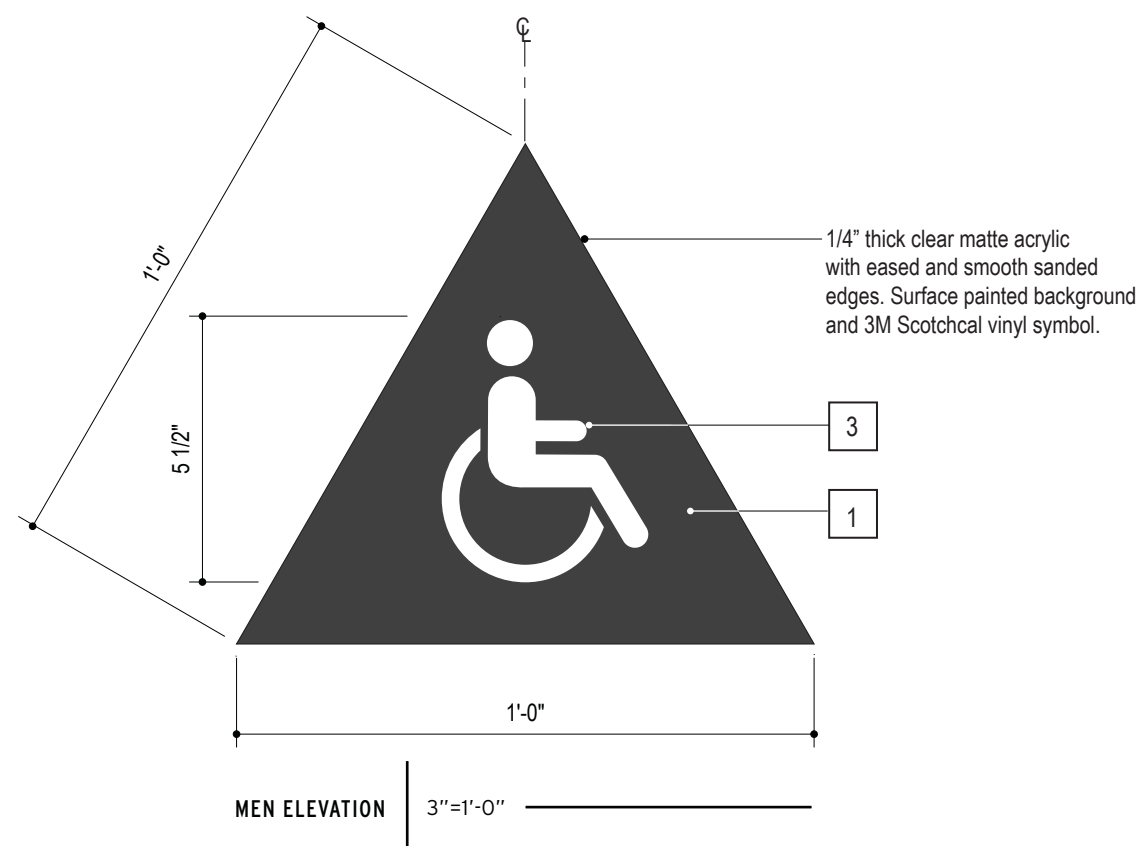


Ease edges to prevent individuals from cutting themselves.

1/4" thick clear matte acrylic with eased and smooth sanded edges. Surface painted background and 3M Scotchcal vinyl symbol.

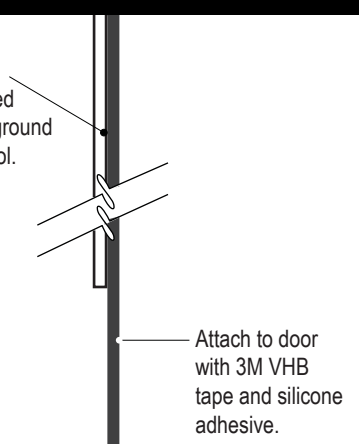


UNISEX SIDE 3"=1'-0"

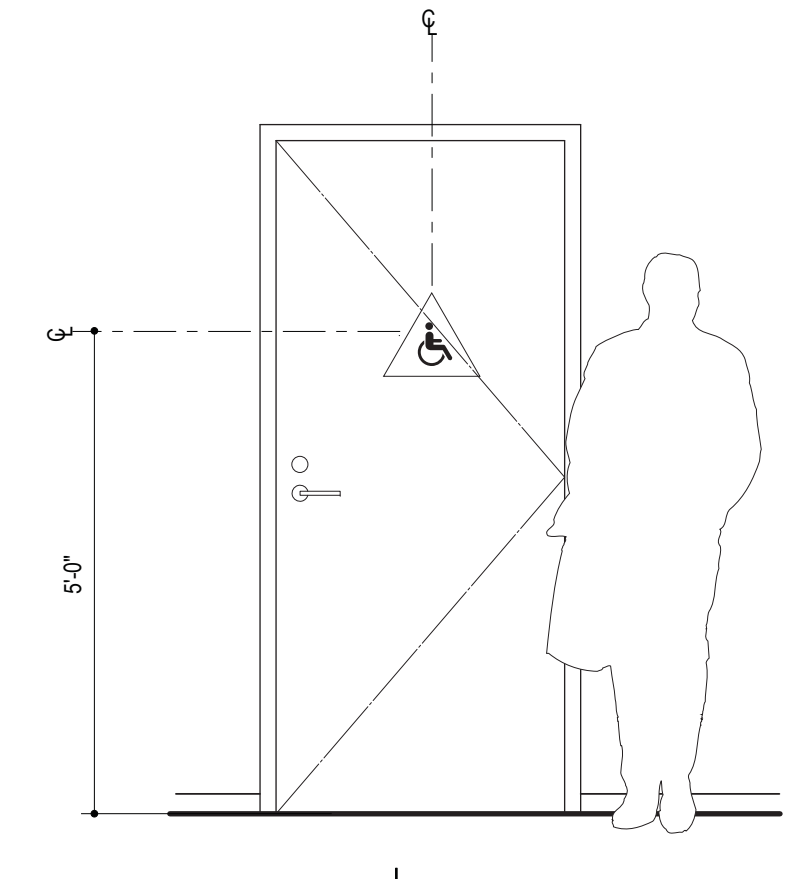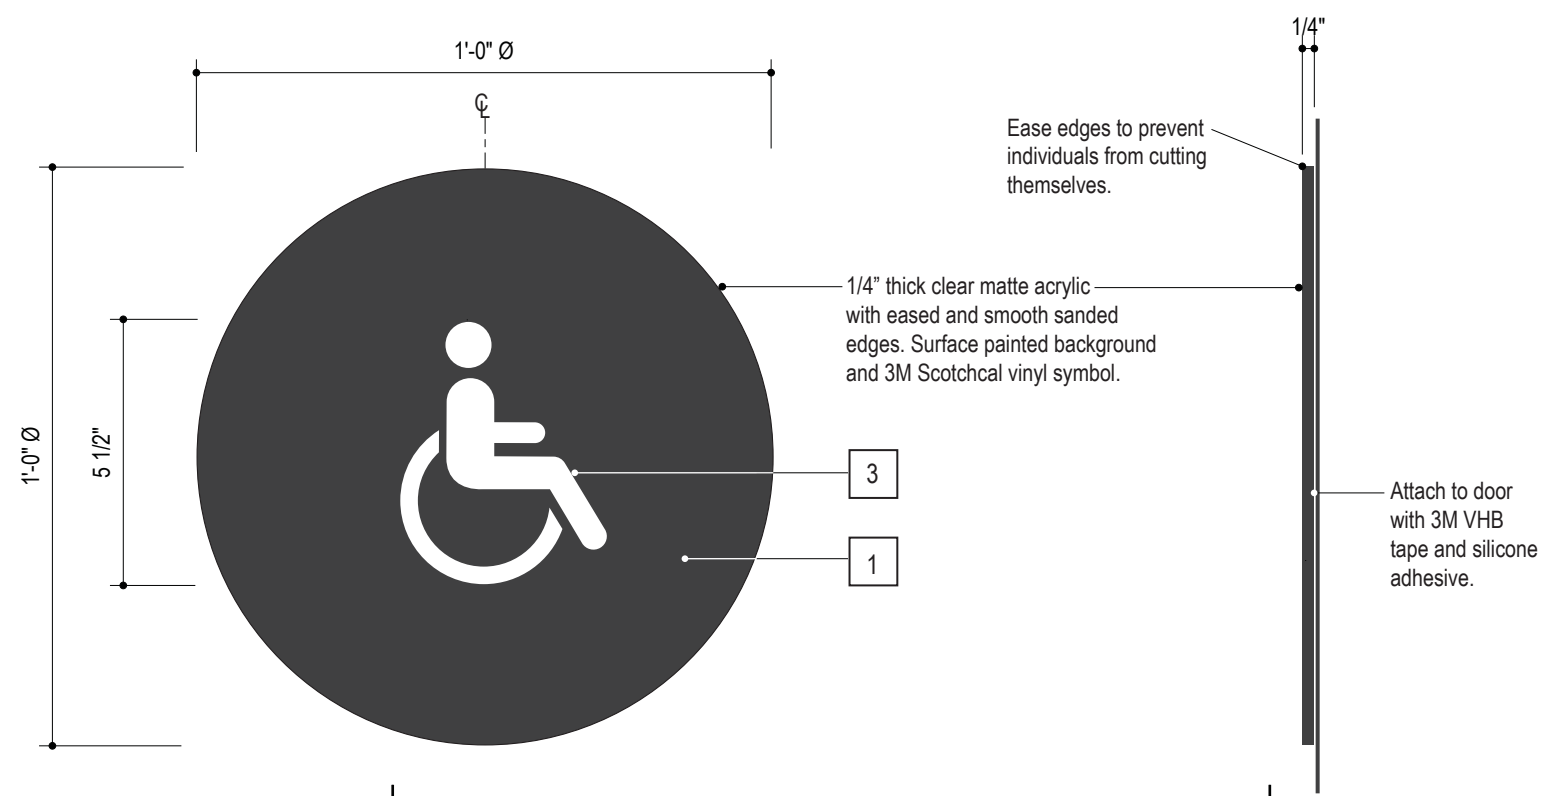


SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)

2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille).
4. An inverted "L" shall precede all numbers in Braille.

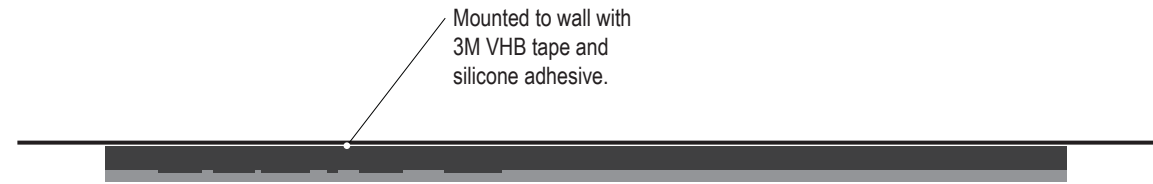


PLAN VIEW | HALF SIZE

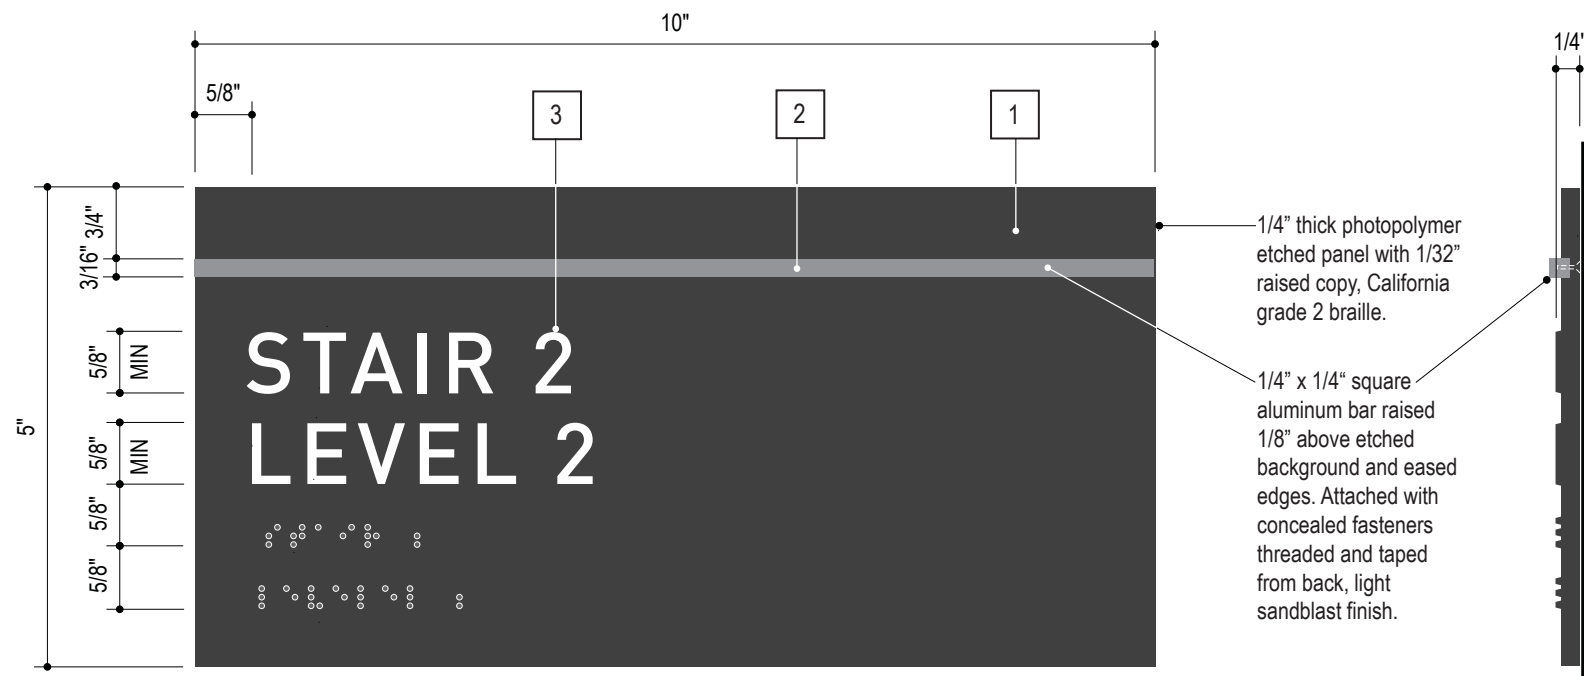

ELEVATION | HALF SIZE

SIDE VIEW | HALF SIZE

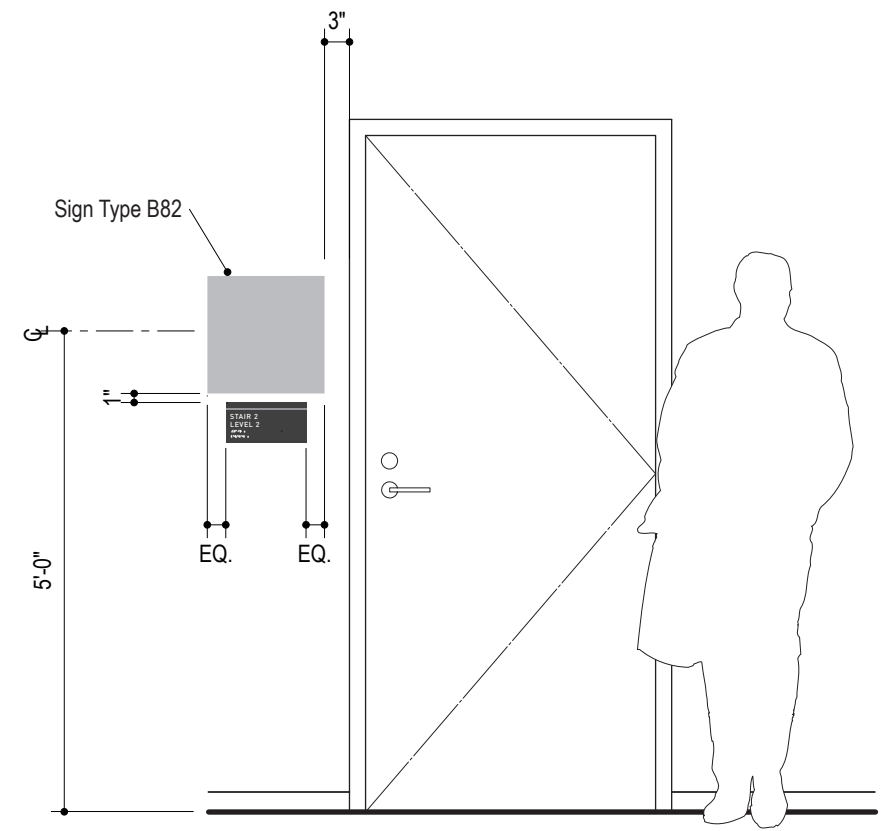


LOCATION ELEVATION | 1/2"=1'-0"


SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)


2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

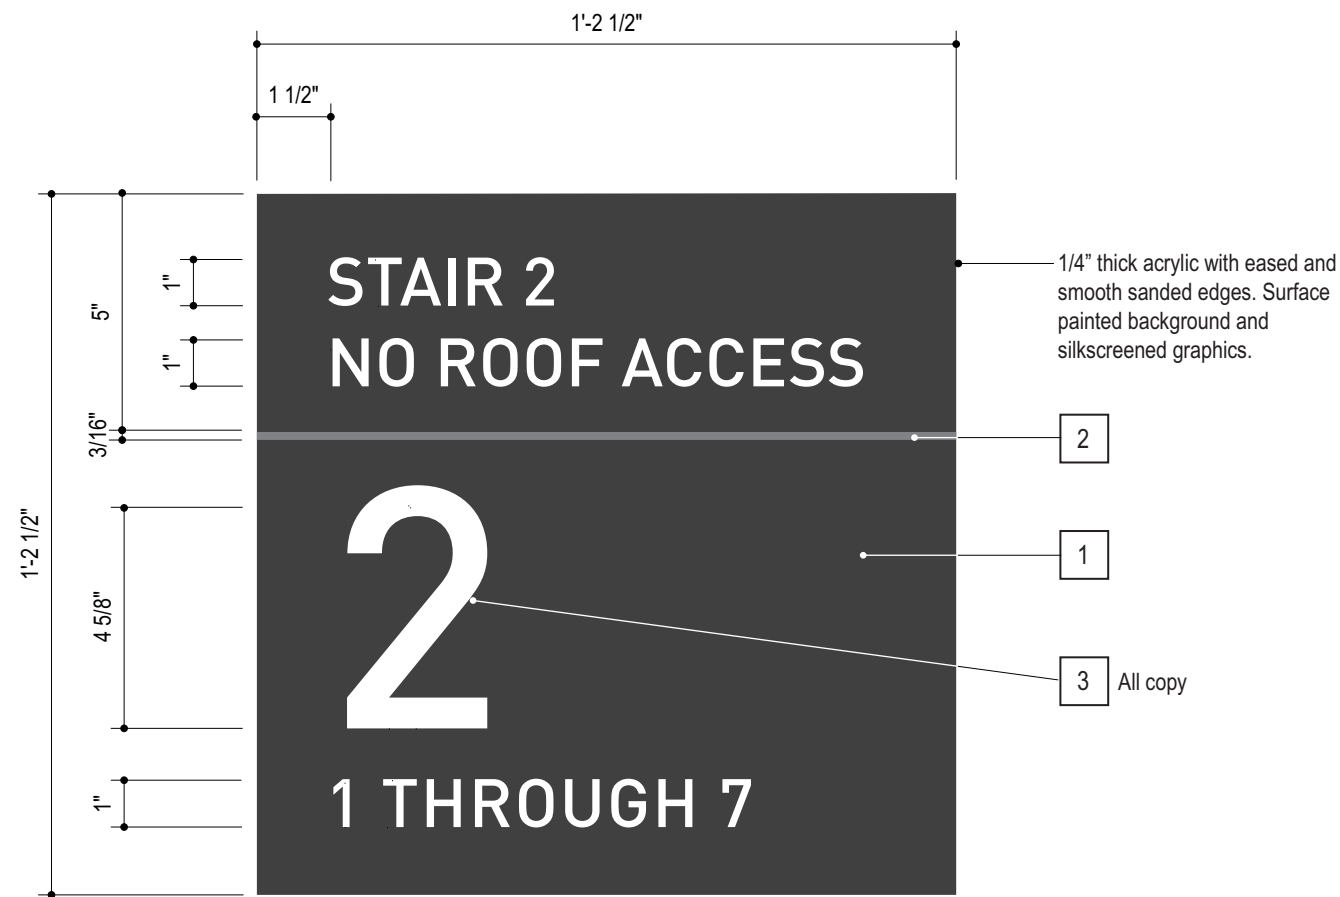

ELEVATION | 3"=1'-0"

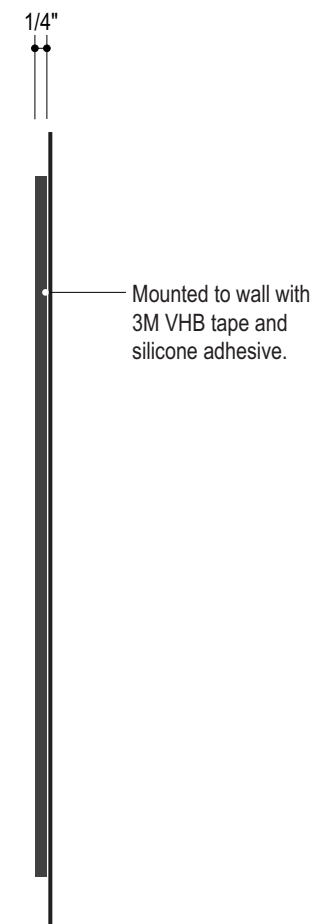


SIDE VIEW | 3"=1'-0"

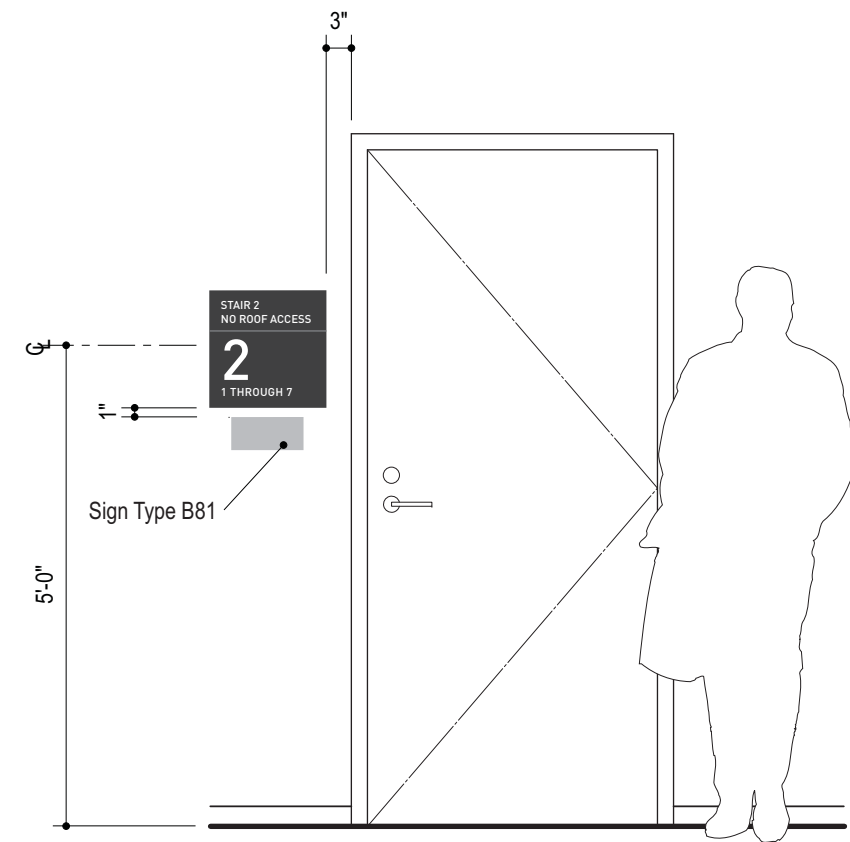


LOCATION ELEVATION | 1/2"=1'-0"

GENERAL NOTES:


1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

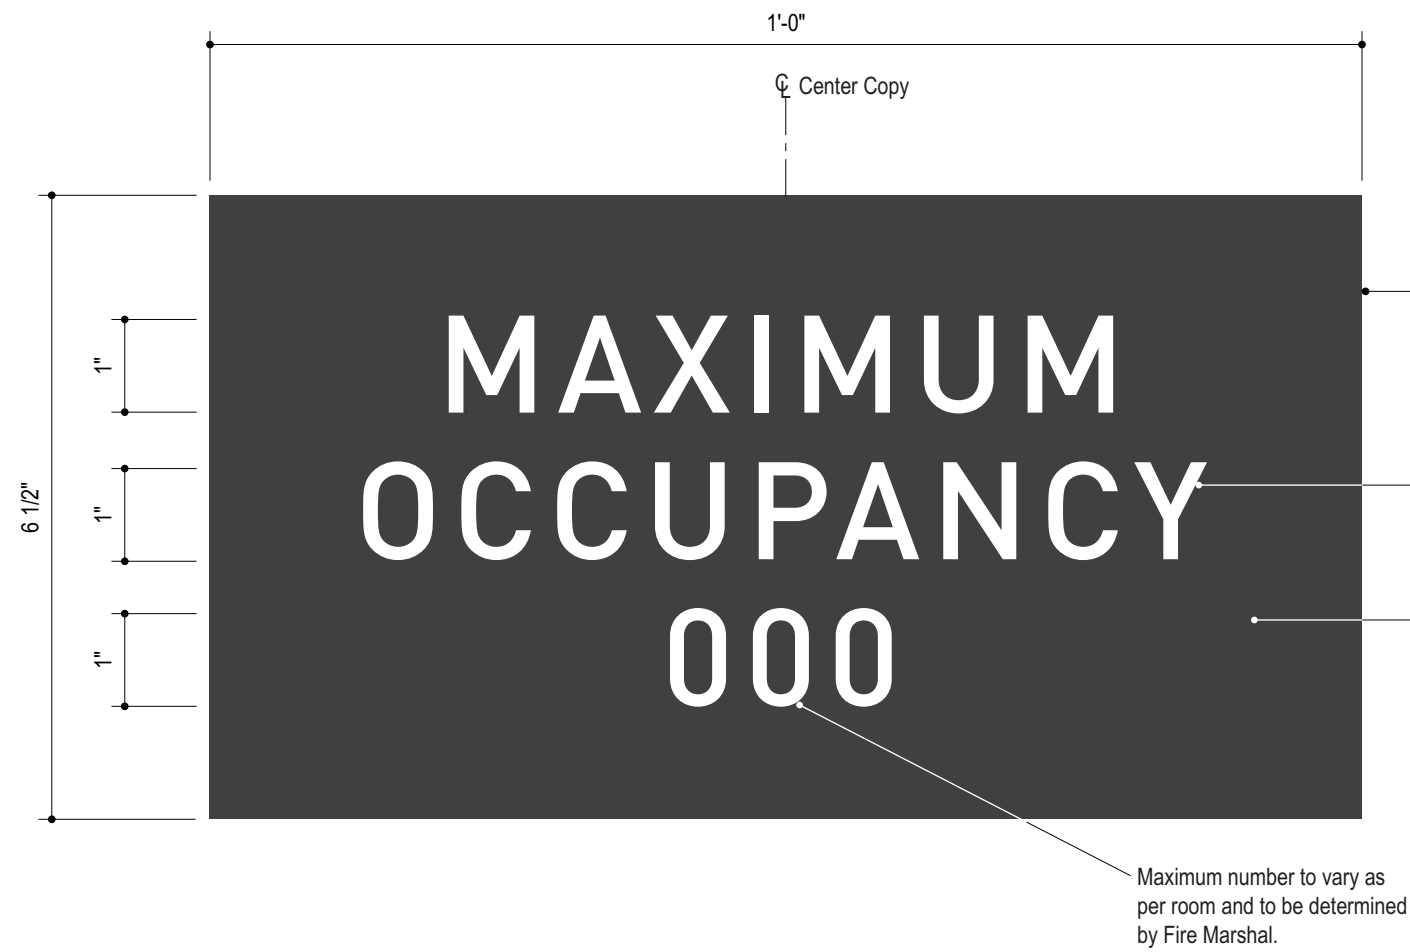

ELEVATION | HALF SIZE

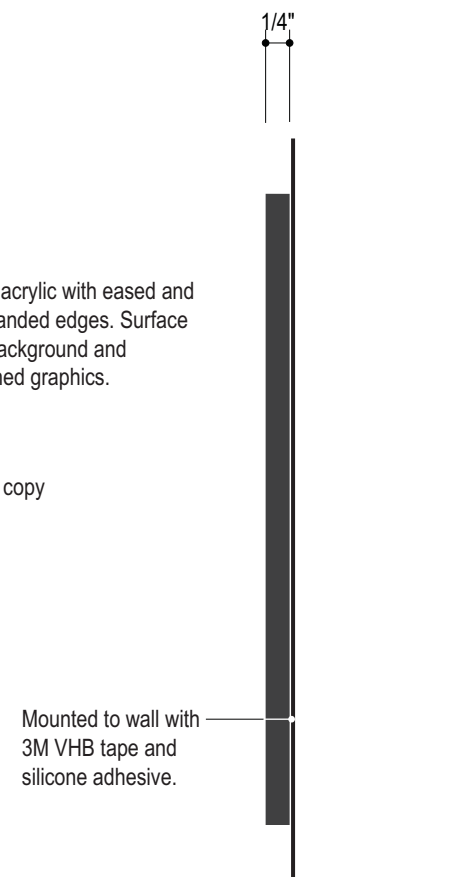

SIDE VIEW | HALF SIZE

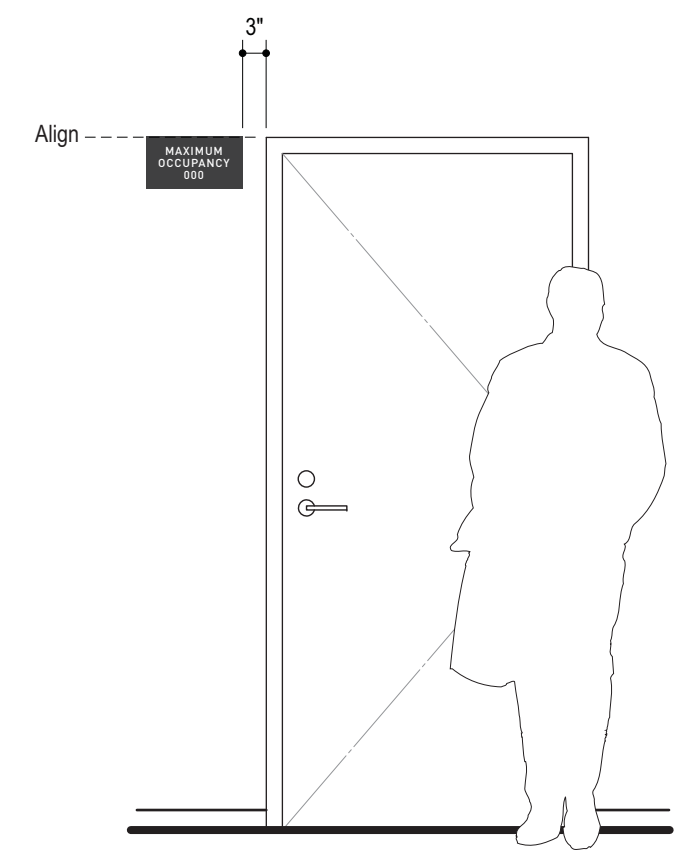


LOCATION ELEVATION | 1/2"=1'-0"



Computer cut 3M Scotchcal vinyl copy with color being gray or white as determined by existing surface color.

ELEVATION


3"=1'-0"

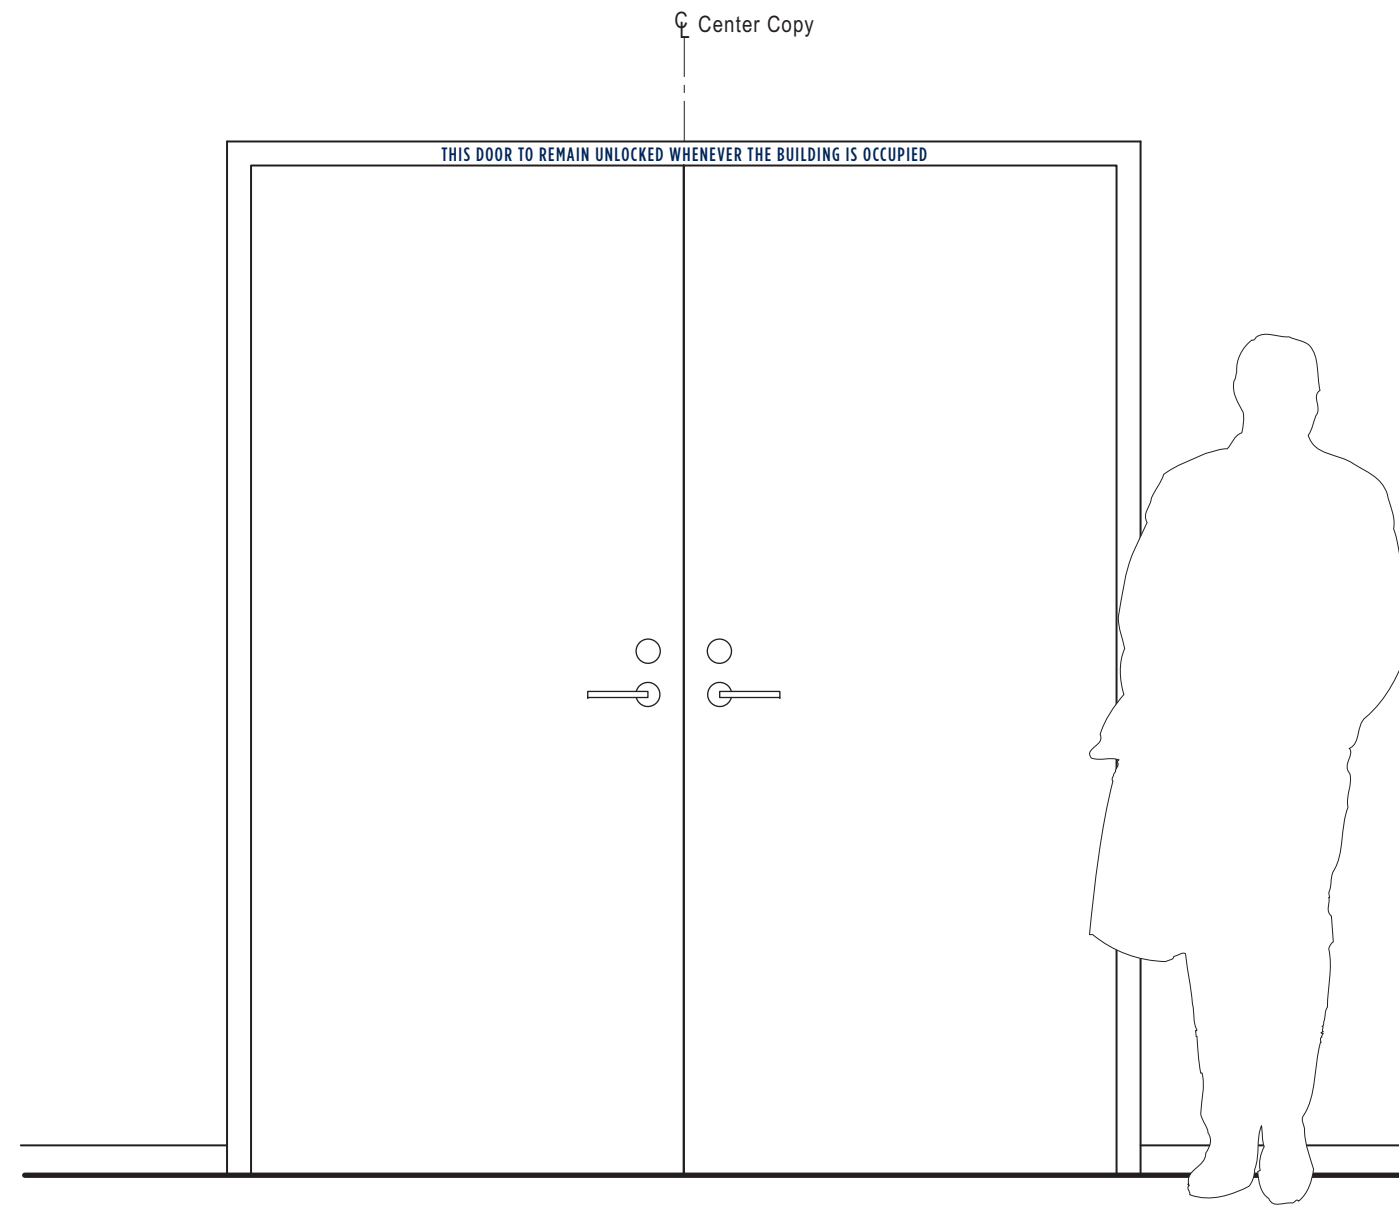


LOCATION ELEVATION

3/4"=1'-0"


SUPERSEDED
Refer to INTERIOR SIGNAGE PROGRAM for
Multidisciplinary Research Building (MRB)

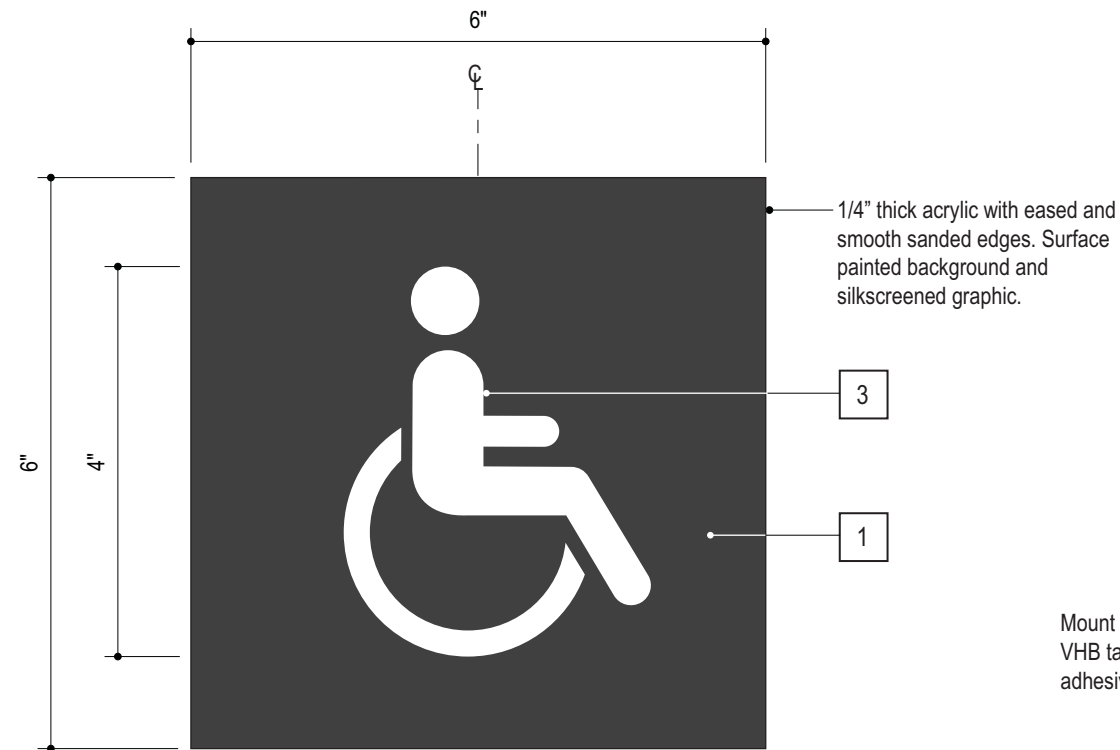


ELEVATION | HALF SIZE

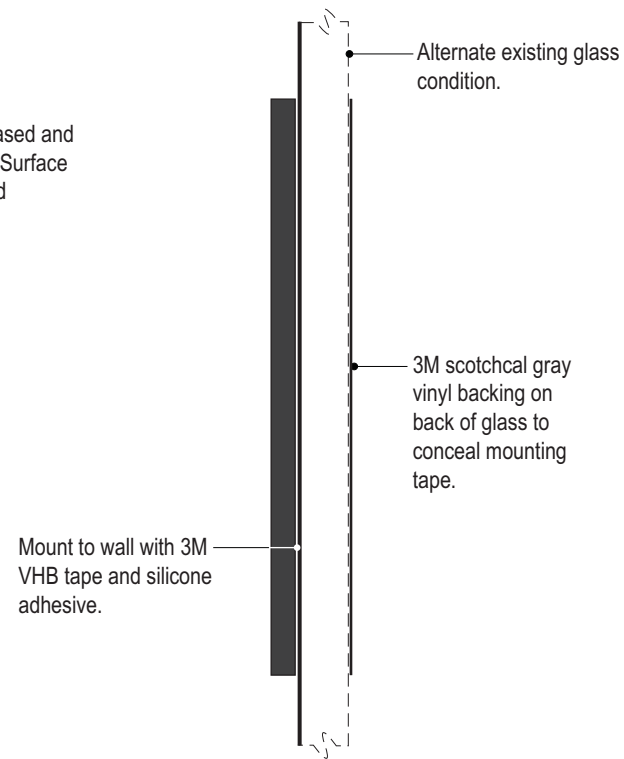

SIDE VIEW | HALF SIZE

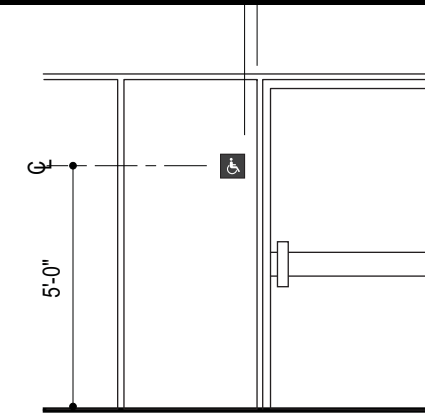

ALTERNATE GLASS MOUNTING | 1/4"=1'-0"

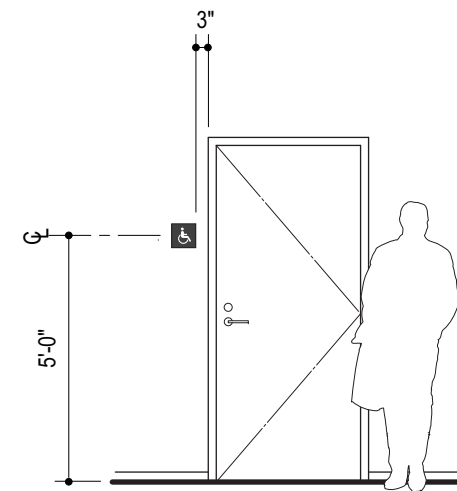


LOCATION ELEVATION | 1/4"=1'-0"

GENERAL NOTES:


1. Copy shown as typical layouts only, actual layouts to be determined and or verified prior to fabrication.
2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.
3. Braille shall be Calif Grade 2 (Contracted Braille).




ELEVATION HALF SIZE

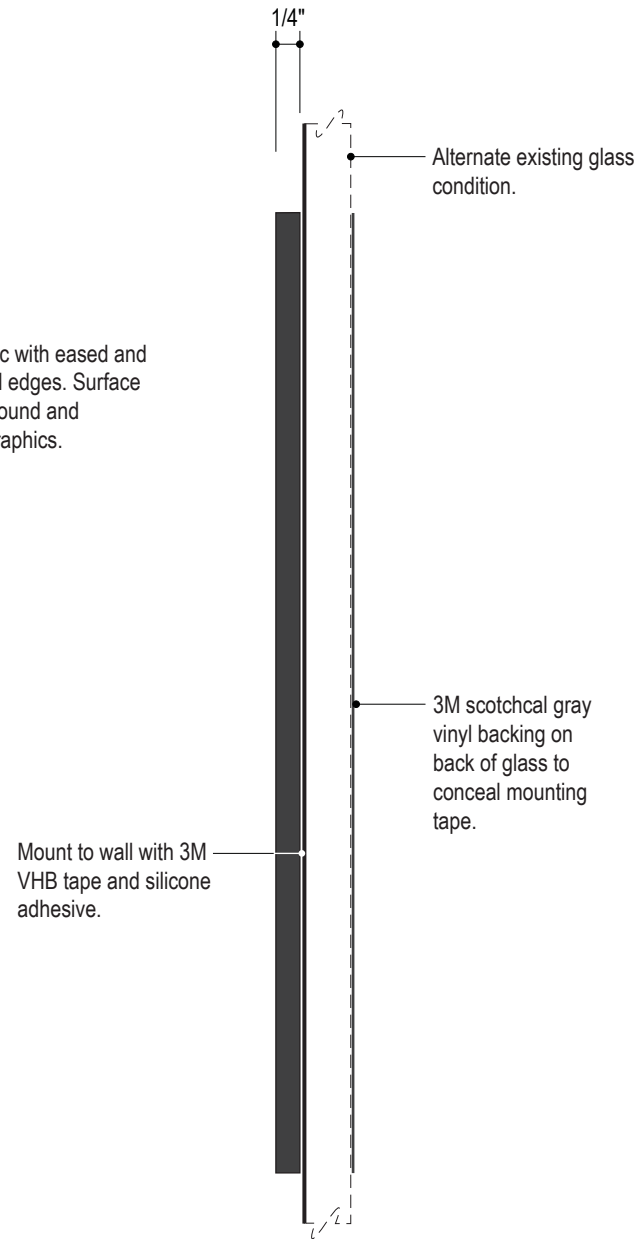

SIDE VIEW HALF SIZE

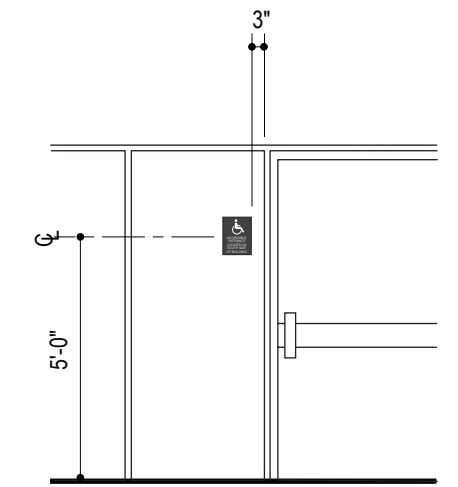

ALTERNATE GLASS MOUNTING 1/4"=1'-0"

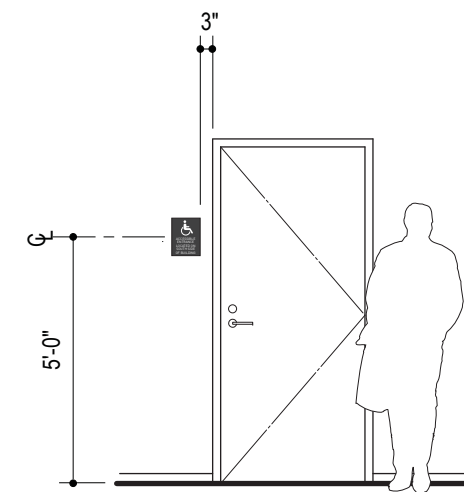


LOCATION ELEVATION 1/4"=1'-0"


SUPERSEDED

Refer to INTERIOR SIGNAGE PROGRAM for Multidisciplinary Research Building (MRB)


2. Sign installer to verify existing mounting conditions and use appropriate attachment method as per condition.

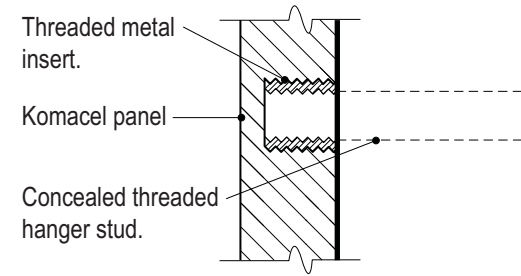


(A) DETAIL FULL SIZE

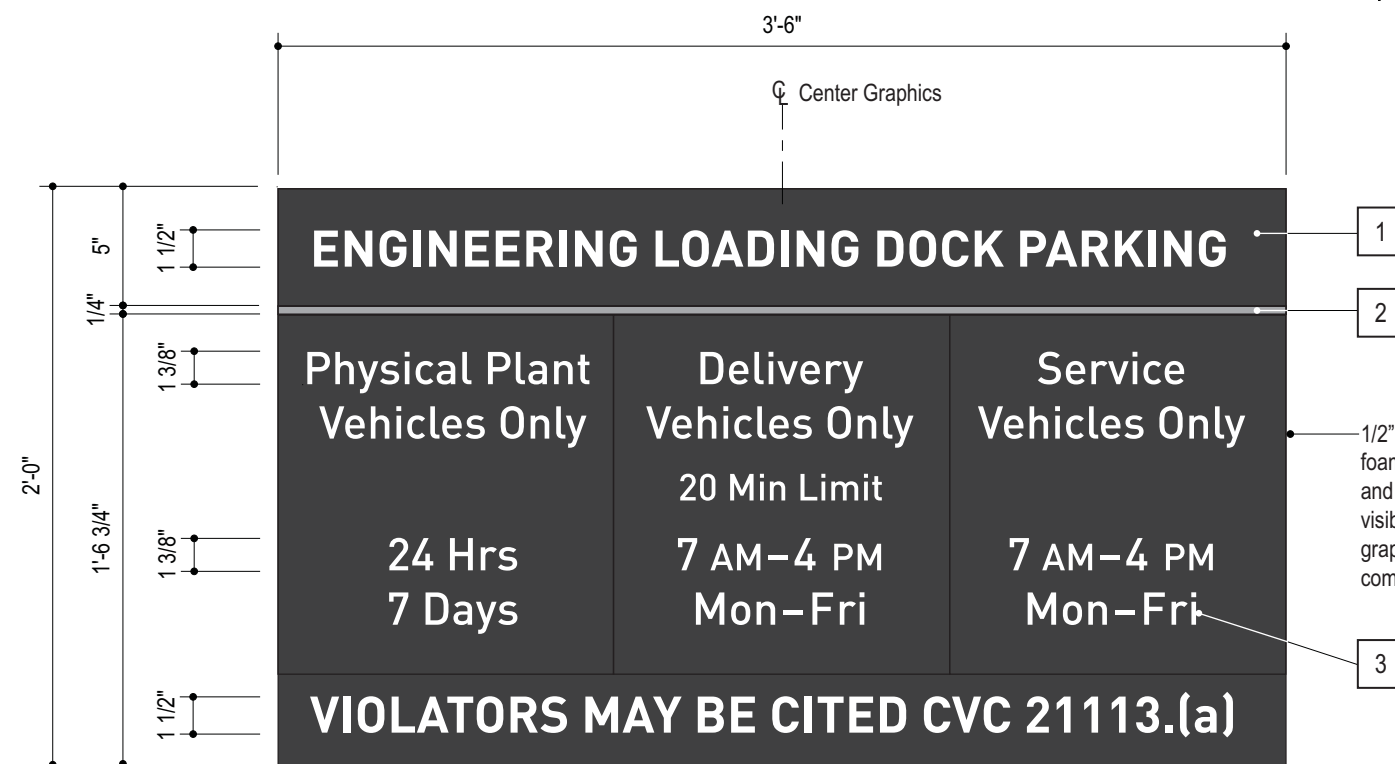

ELEVATION 1 1/2"=1'-0"

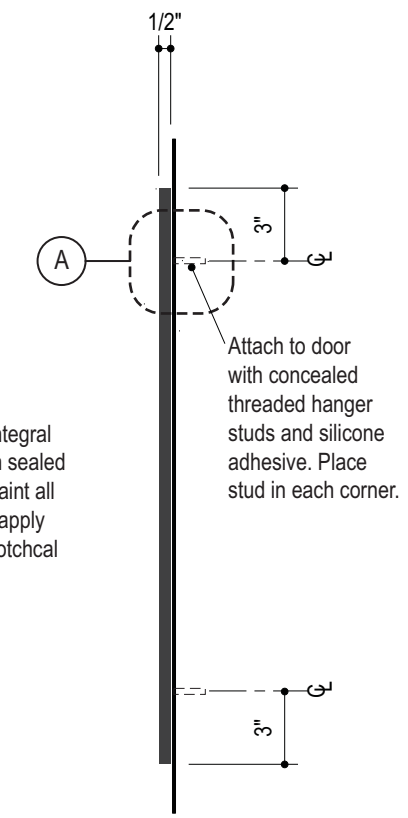

SIDE VIEW 1 1/2"=1'-0"

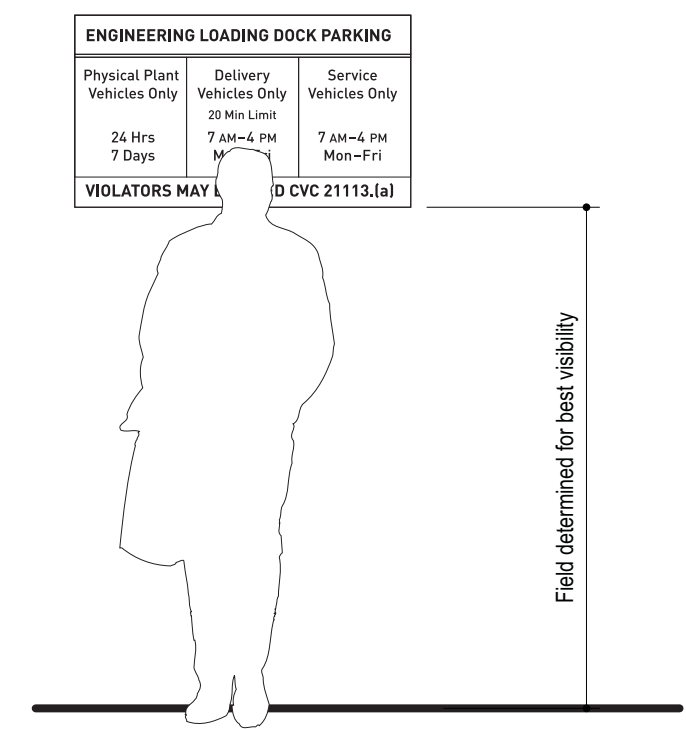

LOCATION ELEVATION 1/2"=1'-0"

ENGINEERING LOADING DOCK PARKING		
Physical Plant Vehicles Only	Delivery Vehicles Only	Service Vehicles Only
24 Hrs 7 Days	20 Min Limit 7 AM-4 PM Mon-Fri	7 AM-4 PM Mon-Fri
VIOLATORS MAY BE CITED CVC 21113.(a)		

Signage Guidelines - Gender Inclusive Facilities

Updated 6/23/2020



Directional Signage – to be used if no gender inclusive facilities are available in a building.



Restroom Door Sign – Details on Page 2



Restroom Room Sign – Details on Page 3

All signs shall meet ADA and CBC Standards.

CBC/ADA Door Signage

SIGN SPECIFICATIONS

1. SIGN PANEL SUBSTRATE
 Finish Size: 9"H x 10 1/2"W
 Material: 1/4" Plaskolite Non-Glare Clear Acrylic (P99)
 Backpaint: Matthews Paint to Match 311-307 Charcoal Grey (Satin Finish)
 Edge Finish: Milled & Unpainted

2. SIGN PANEL SUBSTRATE
 Finish Size: 12"H x 12"W
 Material: 1/4" Plaskolite Non-Glare Clear Acrylic (P99)
 Backpaint: Matthews MAP-LVS202 White (Satin Finish)
 Edge Finish: Milled & Unpainted


3. SYMBOL
 Material: Second-Surface Vinyl To Match 311-307 Charcoal Grey (Opaque)
 Height: 5 1/2" Tall

4. SYMBOL
 Material: Second-Surface 3M #7725-10 Opaque White Vinyl
 Height: 5 1/2" Tall

5. ADHESIVE / TAPE FOR COMPONENTS
 Tape: Thin DT Tape

6. MOUNTING
 Tape: 1/16" Thick Double Sided Foam Tape & Silicone Adhesive

INSTALLATION PLACEMENT
 Height: 60" Bottom of Highest Tactile Letters / 48" AFF Min. to Bottom of Braille
 Placement: 9" OC of Tactile Characters From Opening of Door
 Location: Adjacent to Latch Side of Door. Refer to CSB Installation Standards

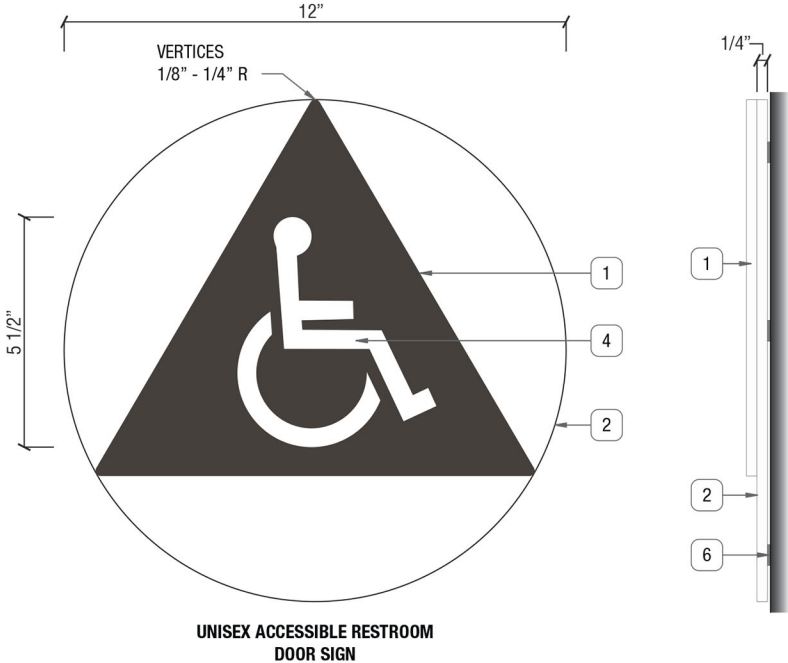

SIGN TYPE - GENDER INCLUSIVE RESTROOM

B SIDE VIEW
 SCALE: 3" = 1'-0"

COLOR LEGEND

	WHITE - MATTHEWS PAINT MAP-LVS202 (SATIN FINISH) / 3M #7725-10 OPAQUE WHITE VINYL
	CHARCOAL GREY - 311-307 CHARCOAL GREY - VINYL / MATTHEWS PAINT TO MATCH (SATIN FINISH)

Restroom Signage (Wall Mt.)

SIGN SPECIFICATIONS

1. SIGN PANEL SUBSTRATE

Finish Size: 6 1/4"H x 10"W
 Material: 1/4" Plaskolite Non-Glare Clear Acrylic (P99)
 Backpaint: Matthews MAP-LVS202 White (Satin Finish)
 Edge Finish: Milled & Unpainted

2. TACTILE APPLIQUE

Material: Modified Acrylic
 Font Height: 5/8" Tall
 Symbol Heights: 4 1/2" / 2 7/8"
 Depth: 1/32" Thick
 Font: DIN Medium
 Color: 311-307 Charcoal Grey

3. BRAILLE

Type: Clear Grade II Braille

4. DECORATIVE METAL BAR

Material: 6063 Aluminum Square 1/4" x 10"
 Finish: #4 Brushed Finish (Horizontal Grain)
 Fastener: Thin DT Tape

5. ADHESIVE / TAPE FOR COMPONENTS

Tape: Thin DT Tape

6. MOUNTING

Tape: 1/16" Thick Double Sided Foam Tape & Silicone Adhesive

INSTALLATION PLACEMENT

Height: 60" Bottom of Highest Tactile Letters / 48" AFF Min. to Bottom of Braille
 Placement: 9" OC of Tactile Characters From Opening of Door
 Location: Adjacent to Latch Side of Door. Refer to CSB Installation Standards



QTY. : 2

TOTAL QTY. : 8

A ELEVATION
 SCALE: HALF-SIZE

SIGN TYPE - GENDER INCLUSIVE
 RESTROOM



B SIDE VIEW
 SCALE: HALF-SIZE

COLOR LEGEND

- WHITE** - MATTHEWS PAINT MAP-LVS202 (SATIN FINISH)
- CHARCOAL GREY** - TACTILE: 311-307 CHARCOAL GREY / MATTHEWS PAINT TO MATCH (SATIN FINISH)
- #4 BRUSHED FINISH (HORIZONTAL GRAIN)**